

C.R.I. Electronic Pump Control

ELCON PLUS Manual

EPP-5LD

Ver.1.1



Conventions used in this manual

In the manual the following symbols will be used:



Generic danger Failure to comply with the safety regulations that follow can irreparably damage the controller or equipment.



Electric shock risk Failure to comply with the safety regulations that follow can cause death or serious personal injury.

WARNINGS

Read this manual carefully before any operation.
Please keep this manual for future use.




WARNING!!

- Before carrying out any installation or maintenance operation, controller must be disconnected from the power supply;
- Don't open the cover during running the controller;
- Don't put wire, metal bar filaments etc into the controller;
- Don't splash water or other liquid over the controller;




CAUTION

- The electrical and hydraulic connections must be carried out by competent, skilled, qualified personnel;
- Never connect AC power to output uvw terminals;
- Ensure the motor, controller and power specifications matching;
- Don't install the controller in the following condition;




mechanical shock



corrosive gas or
corrosive liquid



Extreme heat and cold,
acceptable temperature
range: -25°C +55°C



Salt mist corrosion



Rain and Moisture



flammable material:
solvent

TABLE OF CONTENTS

1 INTRODUCTION	.1.
1.1 Applications	.1.
1.2 Technical parameter & features	.1.
1.3 Controller components	.3.
2 INSTALLATION	.4.
2.1 Electrical connection to the power supply line and electrical pump	.4.
2.2 Function switch setting	.5.
2.3 Parameter Calibration setting & erasing	.6.
3 ELECTRICAL CONNECTION	.7.
3.1 Installing float switch	.7.
3.2 Electrical connection for different application	.8.
3.2.1 Water supply by liquid level control through float switch or liquid probe	.8.
3.2.2 Booster by pressure control through pressure switch & pressure tank	.13.
3.2.3 Drainage by liquid level control through float switch & liquid probe	.17.
4 BASIC OPERATION	.20.
4.1 Switching to MANUAL mode	.20.
4.2 Switching to AUTO mode	.20.
4.3 Pump protection	.20.
5 TROUBLE SHOOTING GUIDE	.21.

RESPONSIBILITY

The manufacturer is not liable for malfunctioning if the product has not correctly been installed, damaged, modified, and /or run outside the recommended work range or run outside the recommended work range or in contrast with other indications given in this manual.

The manufacturer declines all responsibility for possible errors in this operation manual, if due to misprints or errors in copying.

The manufacturer reserves the right to make any modifications to products that it may consider necessary or useful, without affecting the essential characteristics.

1 INTRODUCTION

Thank you for choosing our products, we will supply you with cordial and well-around service as well as ever.

Intelligent Pump Controller is an easy to use, programmable controlling & protection device for direct start, single phase deep well submersible pump, centrifugal pump, pipeline pump etc .

The product has many operation modes by adopting different electric installations. An important feature that makes the difference between The product and common On/Off pump control box is the float switch free in the well. Our special design makes it a very reliable and sensitive protection against pump dry run without installation float switch in the well.

1.1 Applications

The product is useful in all cases we need to control and protect single pump managing its turn-on and turn off by different electric installations.

Typical usage scenarios include:

- Houses
- Flats
- Holidays houses
- Farms
- Water supply from wells
- Irrigations of greenhouses, gardens, agriculture
- Rain water reuse
- Industrial plants
- Waste water tank / Sewage sink

1.2 Technical parameter & features


Main features:

- Built In function switch
 - applied for water supply by liquid level control through float switch
 - applied for booster by pressure control through pressure switch and pressure tank
 - applied for drainage by liquid level control through float switch
- Automatic stops the pump in the case of water shortage, protecting it from dry running without installing float switch in the well
- Auto / Manual switch
- Dynamic LCD displaying pump running state
- Protect the pump against many faults
- Push Button Calibration
- Starts and stops the pump in accordance with the different liquid level or pressure setting
- Reserved space for installing internal start capacitor of pump motor


The following chart shows main technical parameters of The product

Main technical characteristic	
Control characteristic	double liquid level control
	pressure control
Control method	Manual / Auto
Liquid level control characteristic	float switch
Pressure control characteristic	pressure switch (n/c) & pressure tank
Main technical data	
Rated output power	refer to the nameplate
Rated input voltage	refer to the nameplate
Trip response time of over load	5sec-5min
Trip response time of short circuit	<0.1sec
Trip response time of under / over voltage	<5sec
Trip response time of dry run	6sec
Recovery time of over load	30min
Recovery time of under / over voltage	5min
Recovery time of dry run	30min
Trip voltage of over voltage	115% of rated input voltage
Trip voltage of under voltage	80% of rated input voltage
Protection function	Dry run Over load Under voltage Over voltage Pump stalled Short circuit
Main installation data	
Working temperature	-25°C -- +55°C
Working humidity	20% - 90%RH, no drips concreted
Degree of protection	IP22
Install position	Vertical
Unit dimensions (L x W x H)	17×15.5×8.5cm
Unit weight (net)	852g

1.3 Controller components

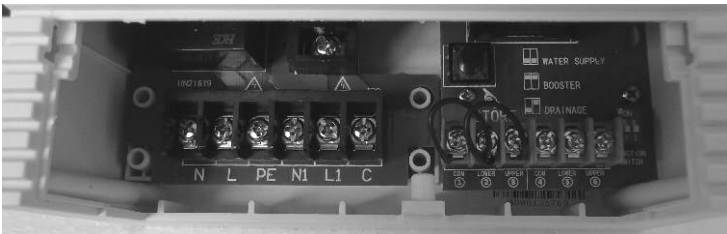


Main terminals for electrical connection to the power supply and electrical pump

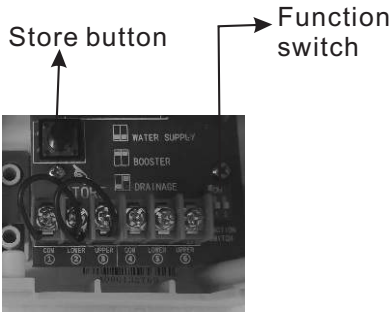

Control terminals for electrical connection to the float switch/pressure switch

LCD Screen

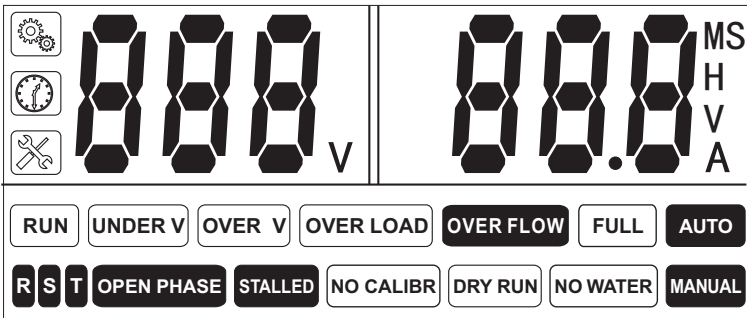


Meaning of the icons shown on the LCD

Icon	Meaning/Description
	pump parameter configuration icon, when this icon appears, pump control box is in parameter adjusting manual;
	time displaying icon, when this icon appears, it means pump control box is displaying some parameter of time, eg: pump dry run triptime (unit:second);
	pump fault icon, when this icon appears, it means pump control box is displaying some fault information;
V	voltage
M	minute
S	second
H	hour
A	ampere

2 INSTALLATION

2.1 Electrical connection to the power supply line and electrical pump

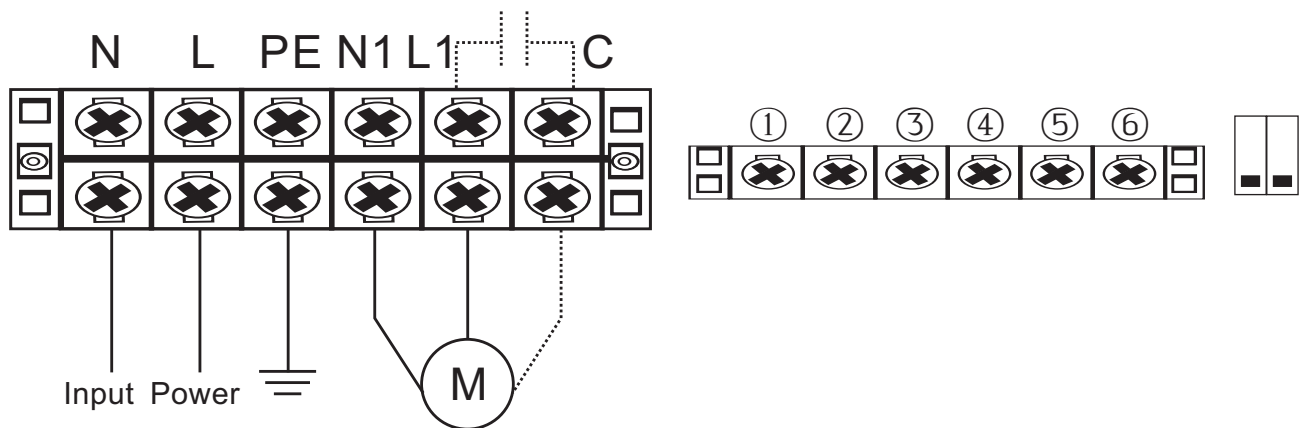


DANGER Electric shock risk

-  Before carrying out any installation or maintenance operation, the product should be disconnected from the power supply and one should wait at least 2 minutes before opening the appliance.
-  Never connect AC power to output N1 L1 C terminals.
-  Don't put wire, metal bar filaments etc into the controller.
-  Ensure the motor, controller and power specifications matching.
-  The electrical and hydraulic connections must be carried out by competent, skilled, qualified personnel.

2.2 Function switch setting

Pump users can set the function switch to meet different application requirement, before setting the function switch, the product should be disconnected from the power supply, after complete the setting, apply power to product and observe the application sign displayed on the LCD conforming to the following list.

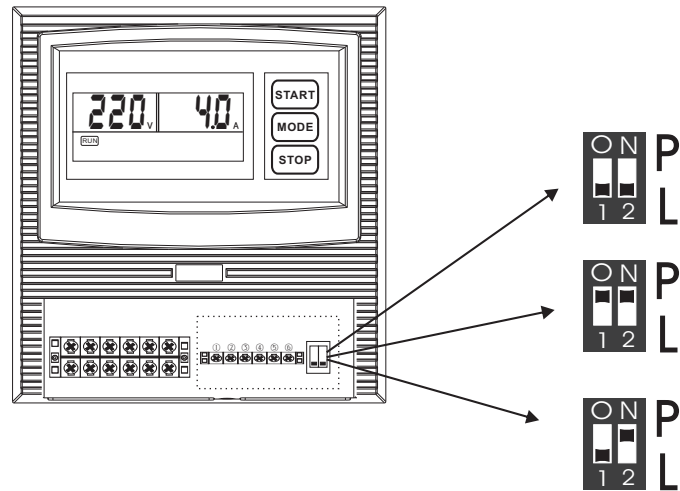

Item	Swith position	Messages & in voltage displaying area	Application
1		000	Applied for water supply by liquid level control through float switch
2		222	Applied for booster by pressure control through pressure switch & pressure tank
3		111	Applied for drainage by liquid level control through float switch


2.3 Parameter Calibration setting & erasing

To achieve best level of protection of the pump, it is essential that parameter calibration must be done immediately after successful pump installation or pump maintenance.


Setting the parameter calibration

- Press the **MODE** key to switch to manual state, make sure the pump not running and LCD screen


displaying:

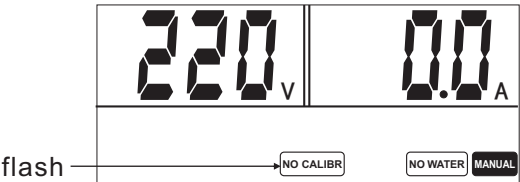


- Press the **START** key to run pump, confirm the pump and all pipe network in normal working state (including voltage, running ampere et); LCD screen displaying:

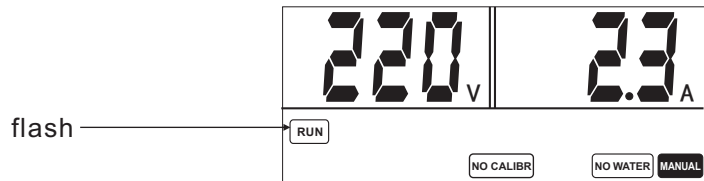

- Hold pressing the  key and release, the product makes a "Di" sound and starts countdown, LCD screen displaying:

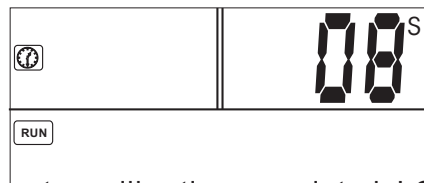

- product is ready for running.
- Pump stops running and parameter calibration completed, LCD screen displaying:

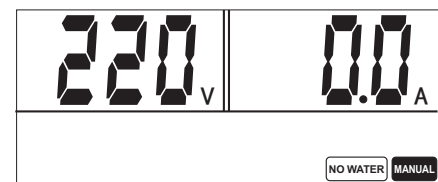


Erasing former parameter calibration


When pump is reinstalled after maintenance or new pump is installed, user must erase the former parameter calibration and a new calibration must be done.

Erasing the parameter calibration

- Press the **MODE** key to switch to manual state, make sure the pump not running and LCD screen displaying:

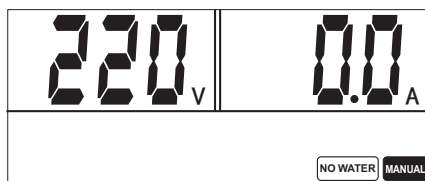


- Hold pressing the **STOP** key and release till product makes a "Di" sound, product recover the default factory setting and LCD screen displaying:

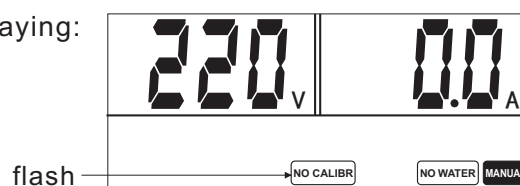

3 ELECTRICAL CONNECTION


3.1 Installing liquid probe & float switch

Liquid probe installation

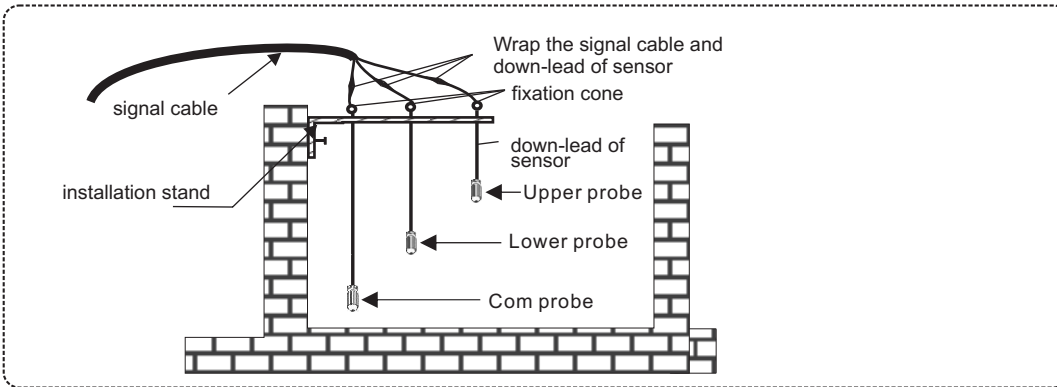


! In event of high risk of electric storms (lightning) or when liquid medium in well or tank or sump is very dirty it is recommended float switch is used.

Float switch installation


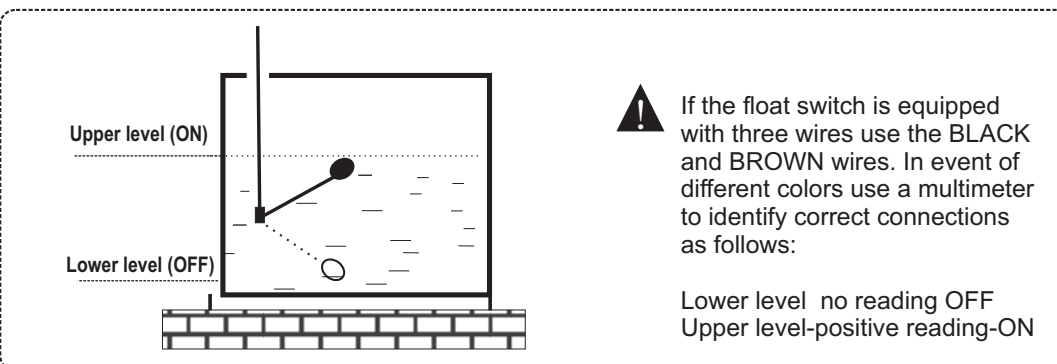




! DO NOT ENCASE SENSOR LEADS, FLOAT SWITCH WIRE OR SIGNAL CABLES IN METAL PIPES. USE PVC OR PE TUBING.


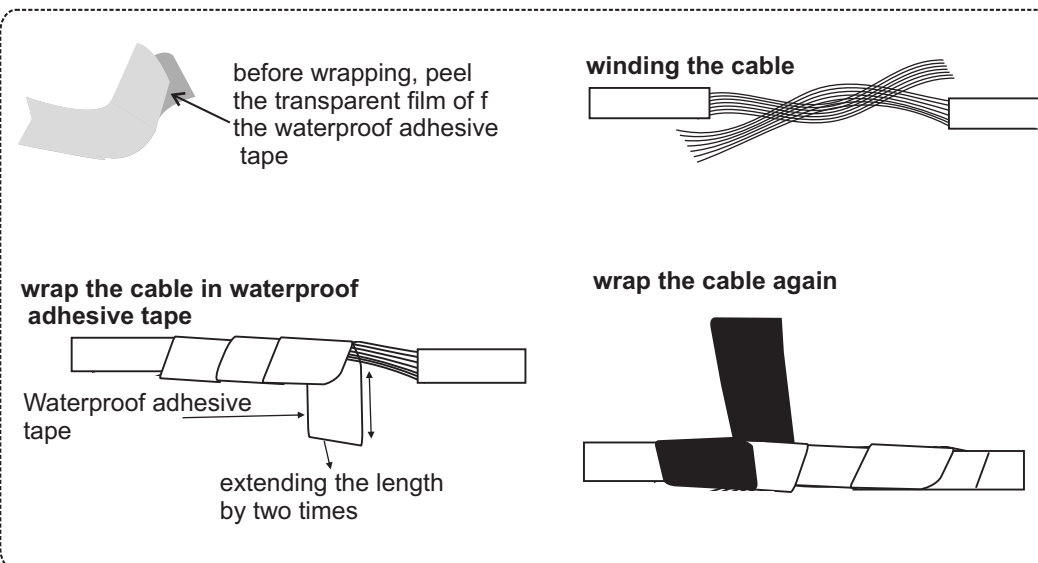




3.2 Electrical connection for different application

3.2.1 Water supply by liquid level control through float switch or liquid probe

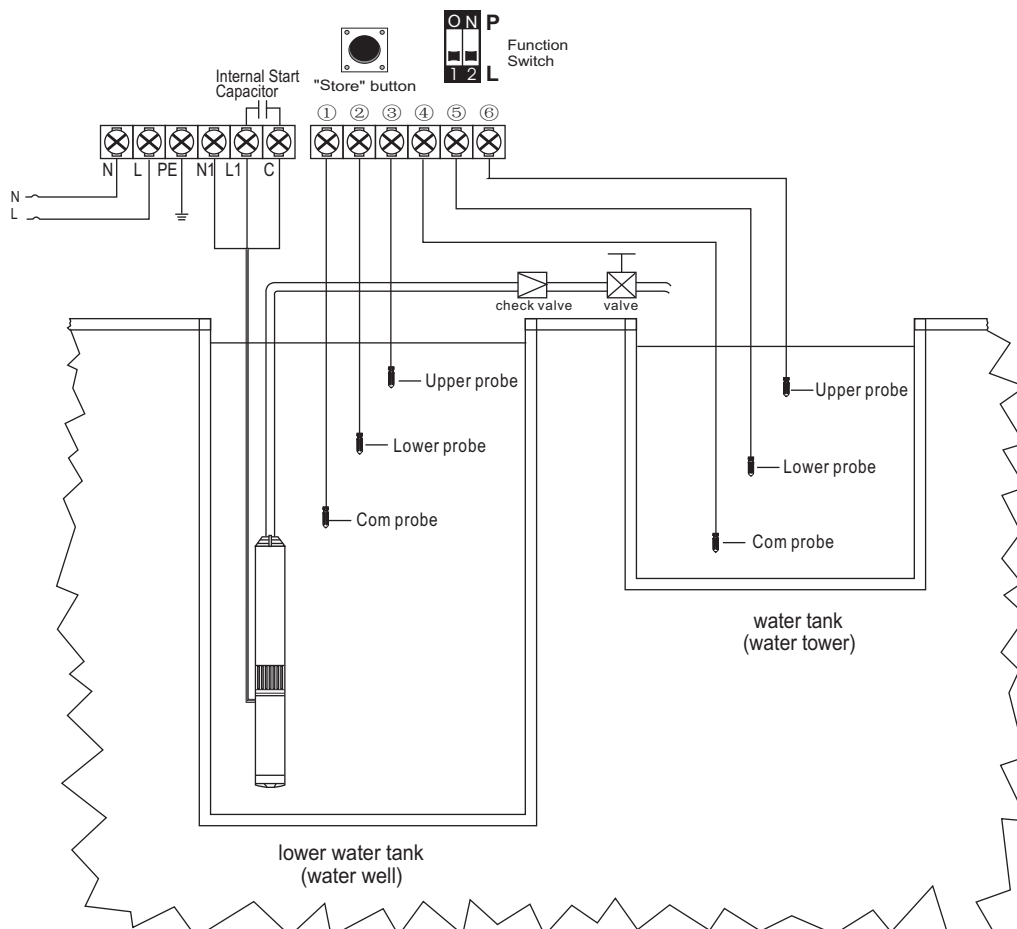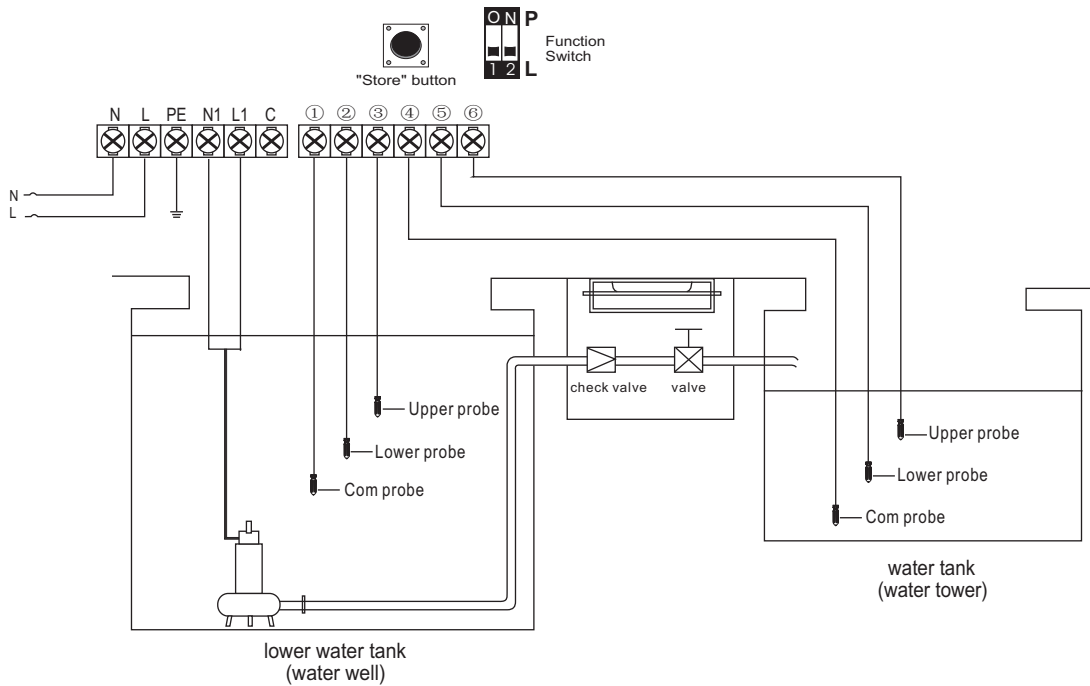

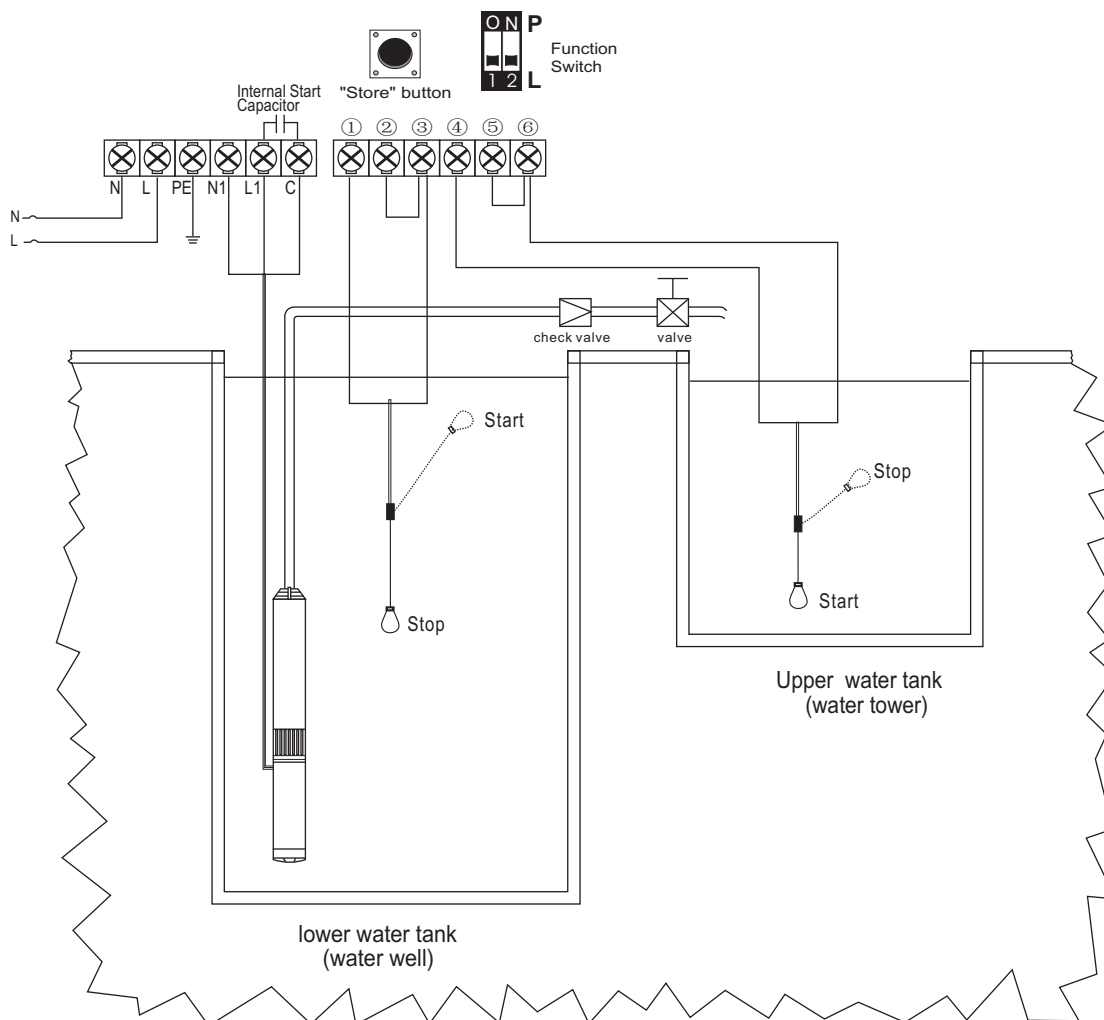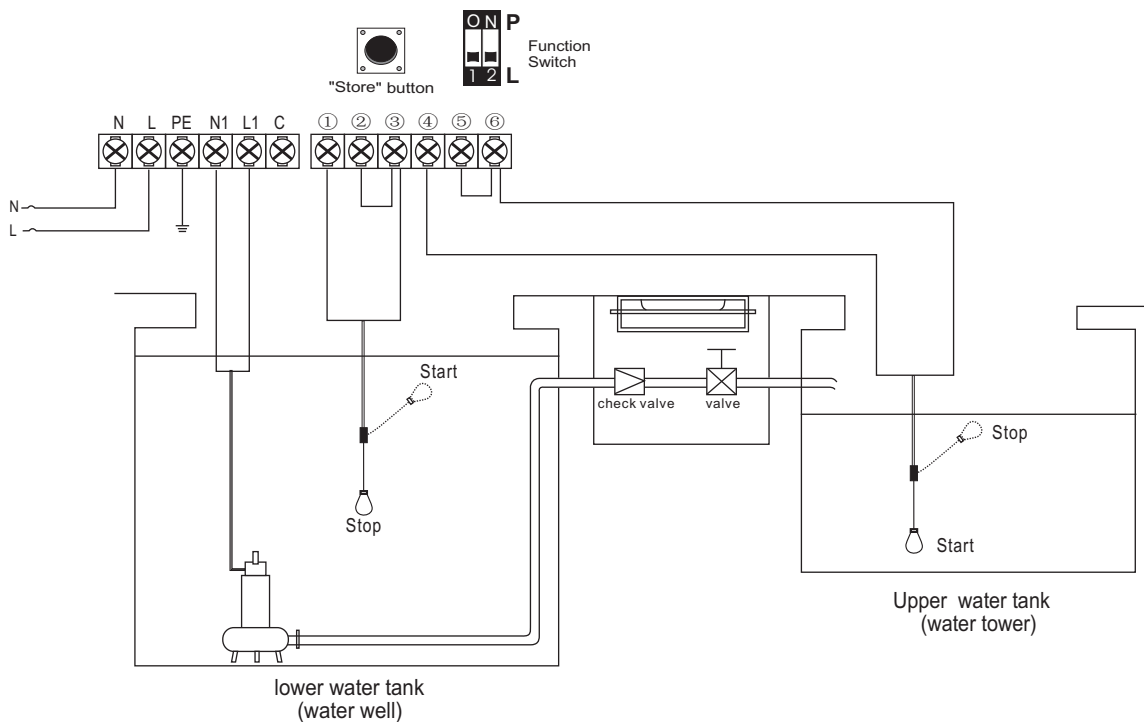

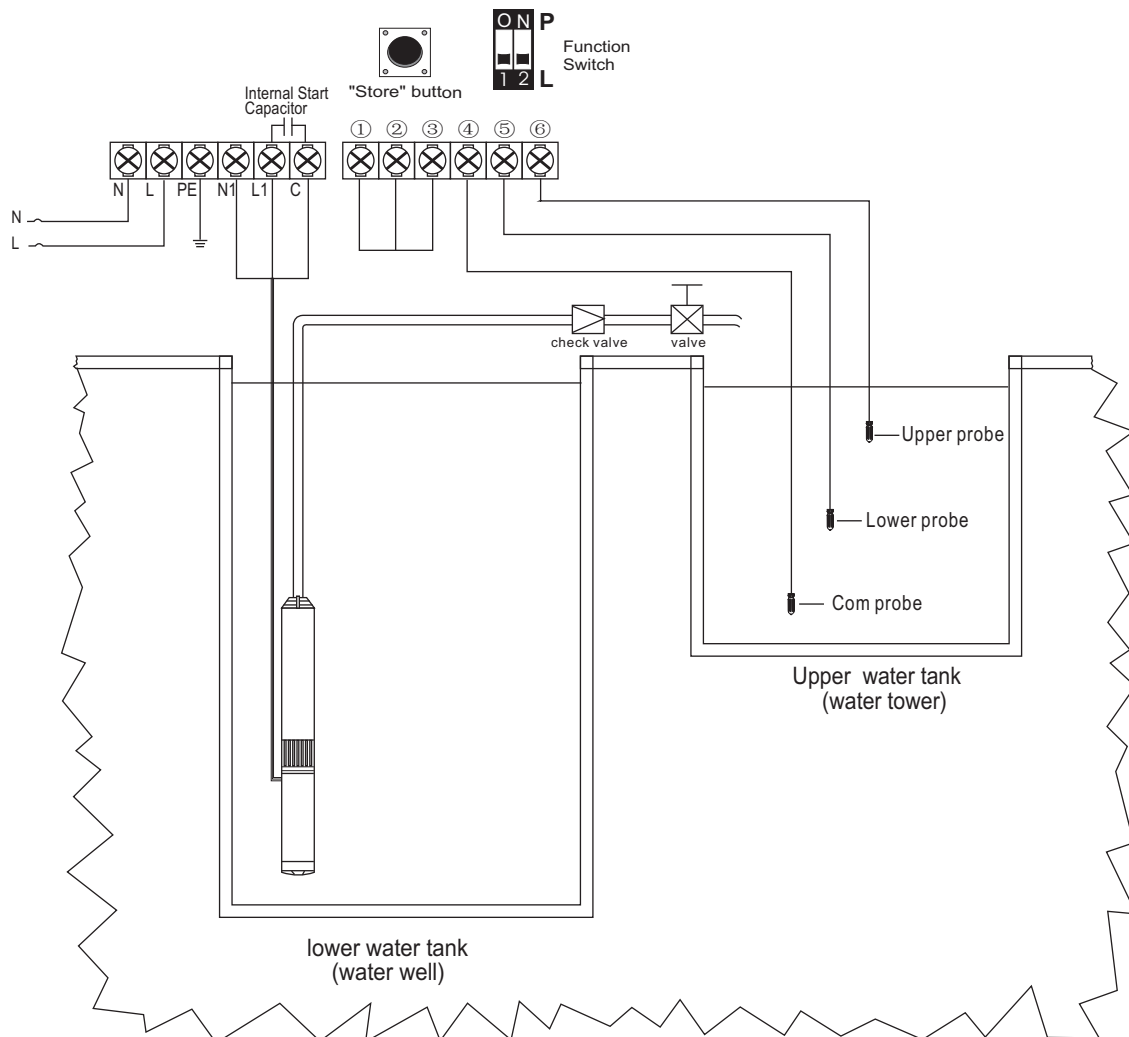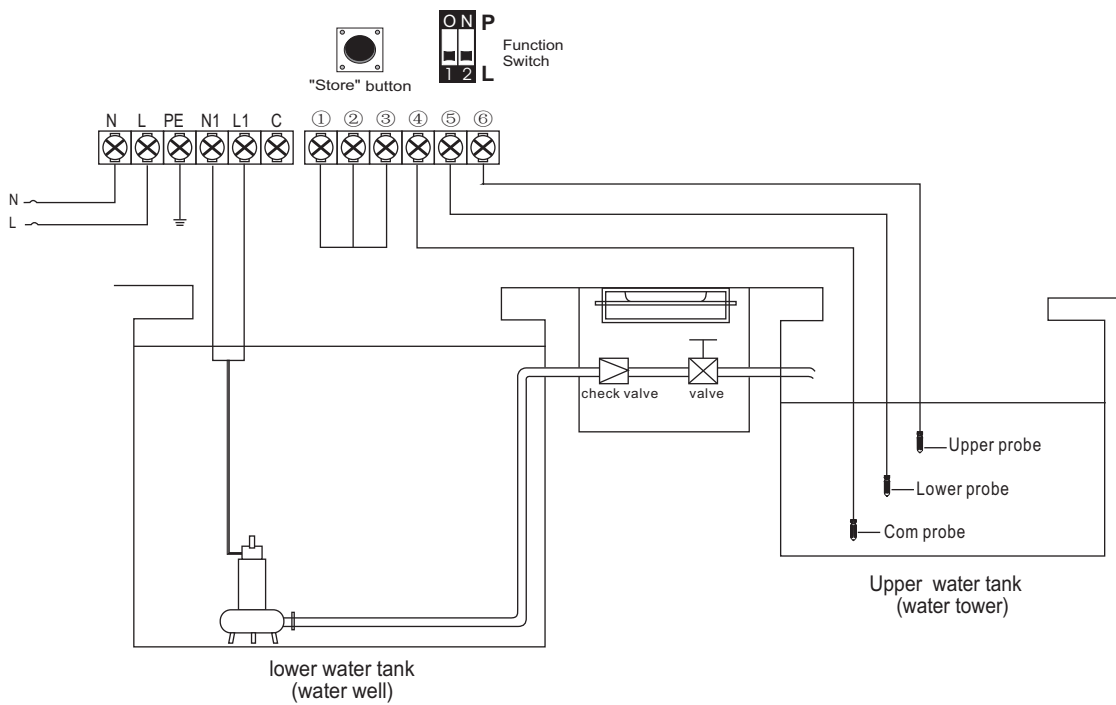

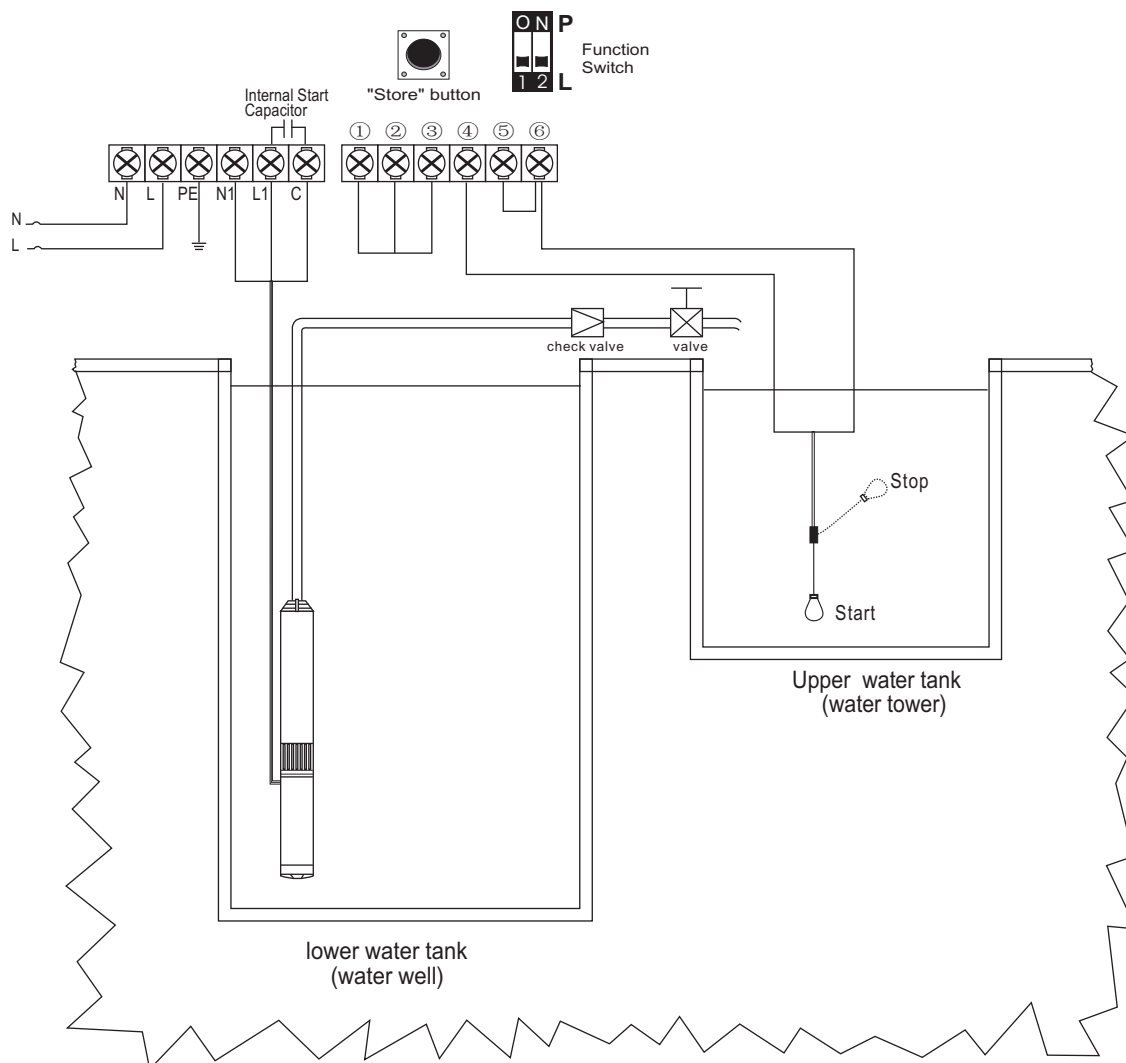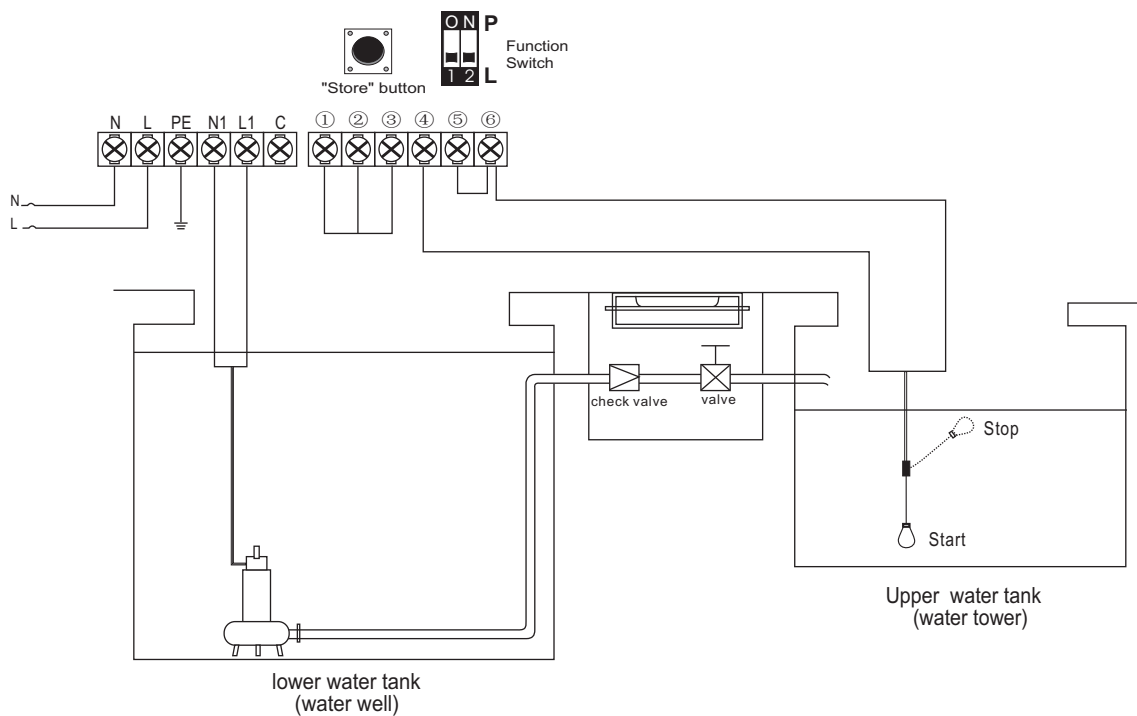

1). Starting condition

liquid level in the water tank is below Lower probe (float switch: Down level) and liquid level in the water well is above Lower probe (float switch: Up level), the product will run pump;

2). Stop condition

liquid level in the water tank reaches Upper probe (float switch: Up level) or liquid level in the water well is below Lower probe (float switch: Down level); the product will stop pump running;


3). The probe / sensor free in the water well



as the product has reliable and automatic stop function against pump dry-run (dewatering), if it is used in submersible pump for deep well, pipeline pump or other situations when it is inconvenient to install lower liquid probe in the well, pump users can put terminals ①、②、③ in short circuit, which minimize the troubles and costs.



4). Meaning of the messages & graphic shown on the LCD screen

Message	Description
	Liquid level in the upper water tank / water tower reaches Upper probe (Float Switch: Up level), pump stops running;
	Liquid level in the well is below the pump intake, pump stops running;
	liquid level in the lower water tank / water well is below Lower sensor/probe (float switch: Down level)

3.2.2 Booster by pressure control through pressure switch & pressure tank

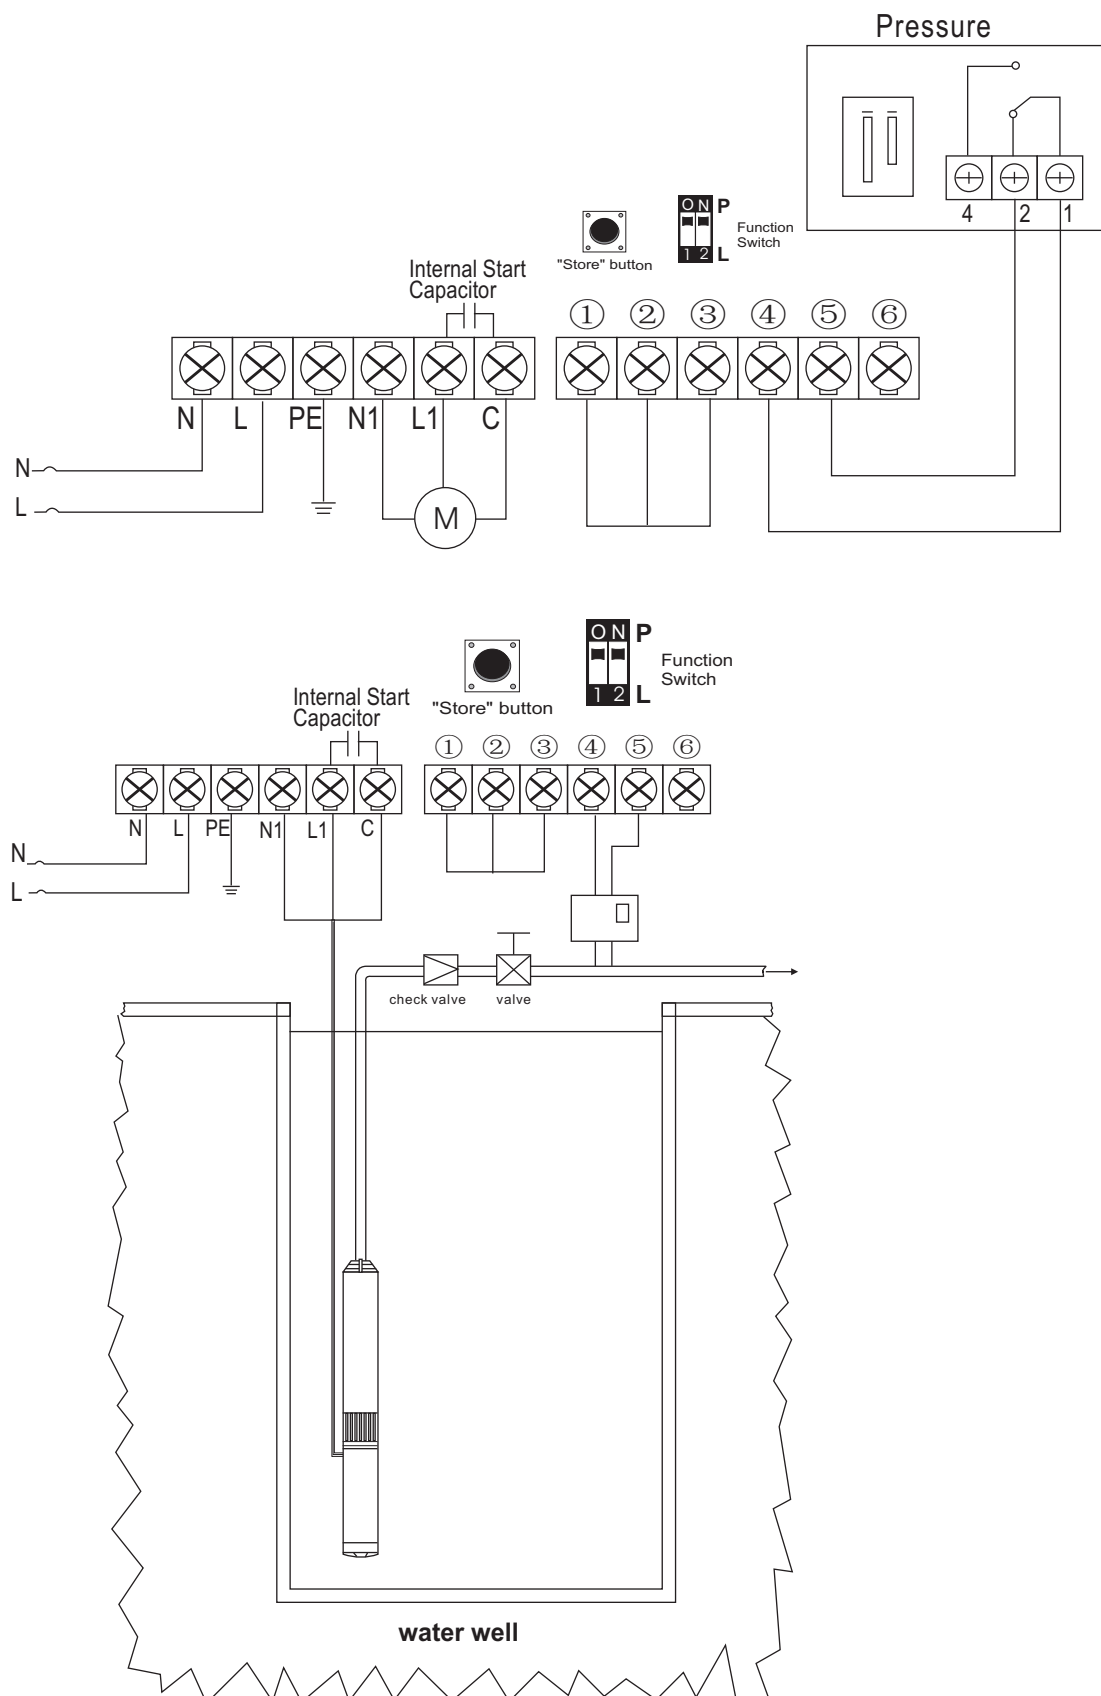

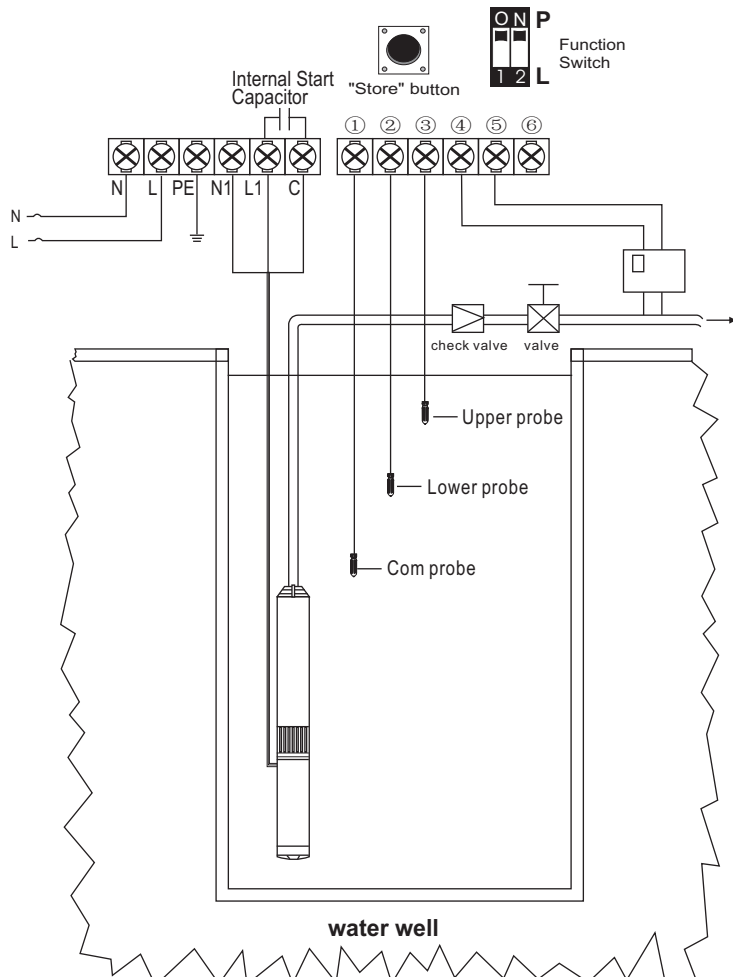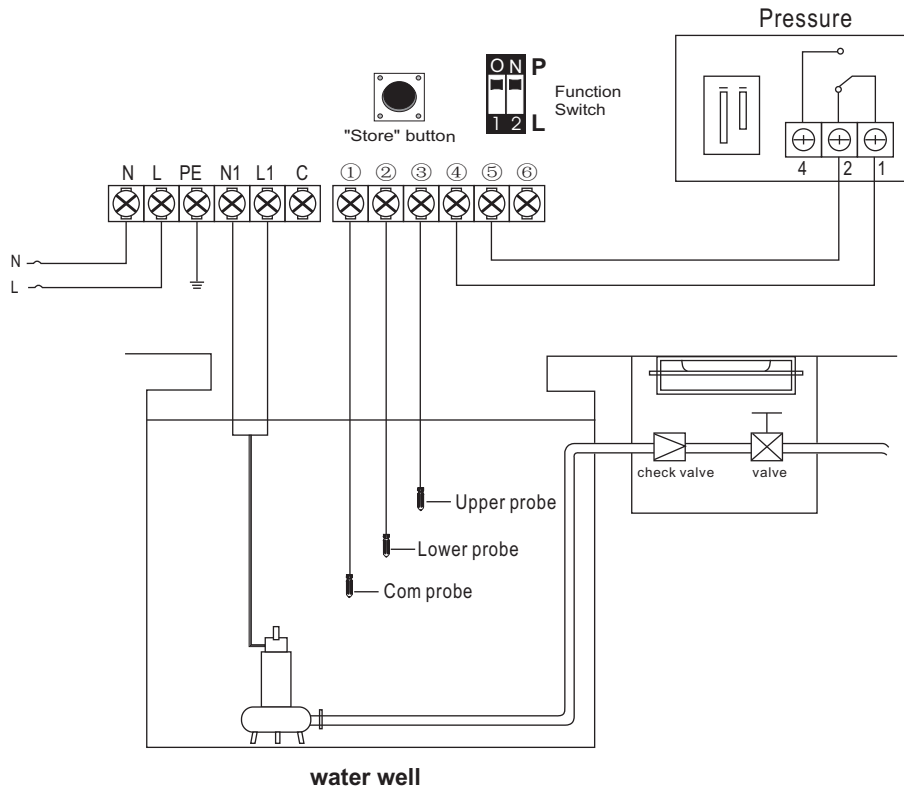

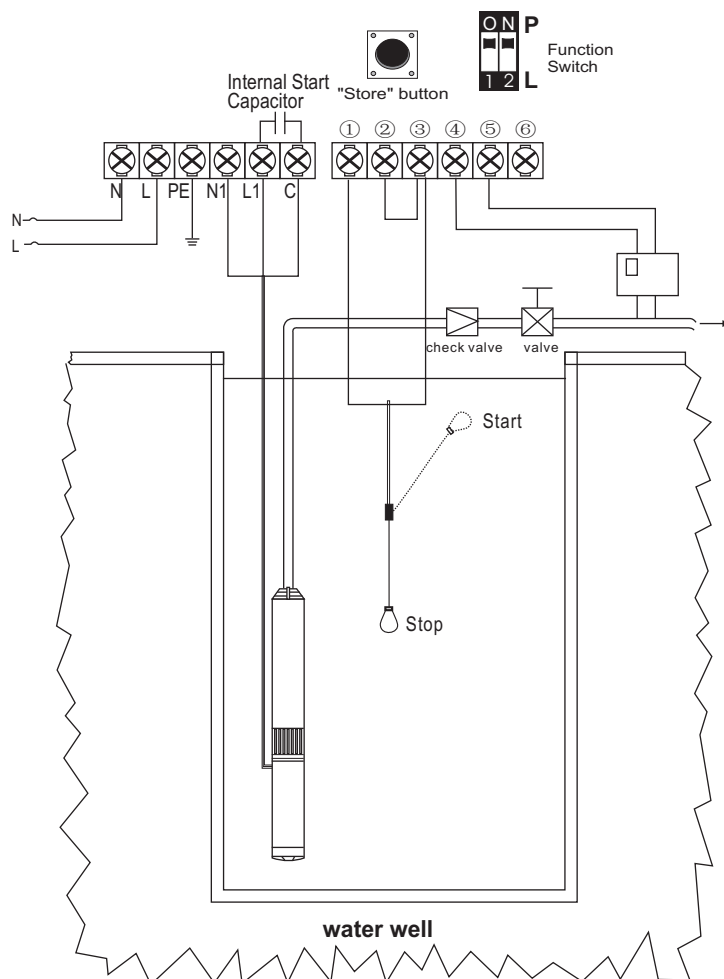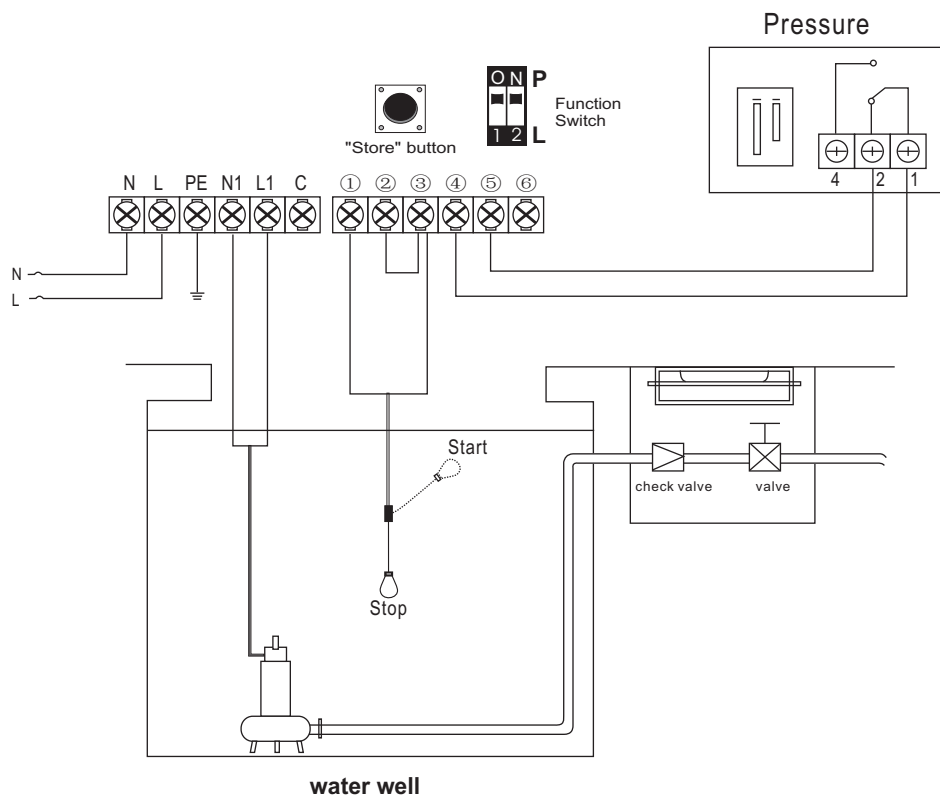

1). Starting condition

there is no pressure in the pipeline or pressure tank, contacting point of pressure switch is ON and liquid level in the water well is above Lower probe (float switch: Up level), the product will run pump;

2). Stop condition

there is full pressure in the pipeline or pressure tank, contacting point of pressure switch is OFF, the product will stop pump running;

Note: pressure switch with N/C (normal close) contacting point:

no pressure, contacting point is ON; meet the pressure setting, contacting point is OFF



3). The probe / sensor free in the water well



as the product has reliable and automatic stop function against pump dry-run (dewatering), if it is used in submersible pump for deep well, pipeline pump or other situations when it is inconvenient to install lower liquid probe in the well, pump users can put terminals ①、②、③ in short circuit, which minimize the troubles and costs.

4). Meaning of the messages & graphic shown on the LCD screen

Message	Description
	There is full pressure in the pipeline or pressure tank, contacting point of pressure switch is OFF, pump stops running;
	Liquid level in the well is below the pump intake, pump stops running;
	liquid level in the lower water tank / water well is below Lower sensor/probe (float switch: Down level)

3.2.3 Drainage by liquid level control through float switch & liquid probe

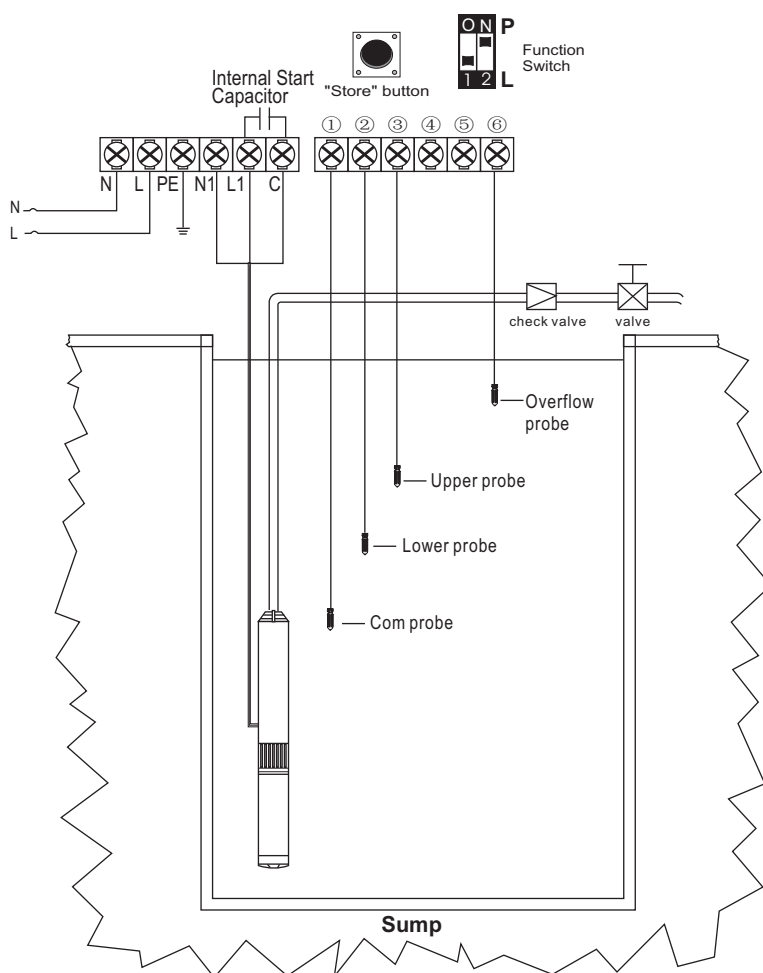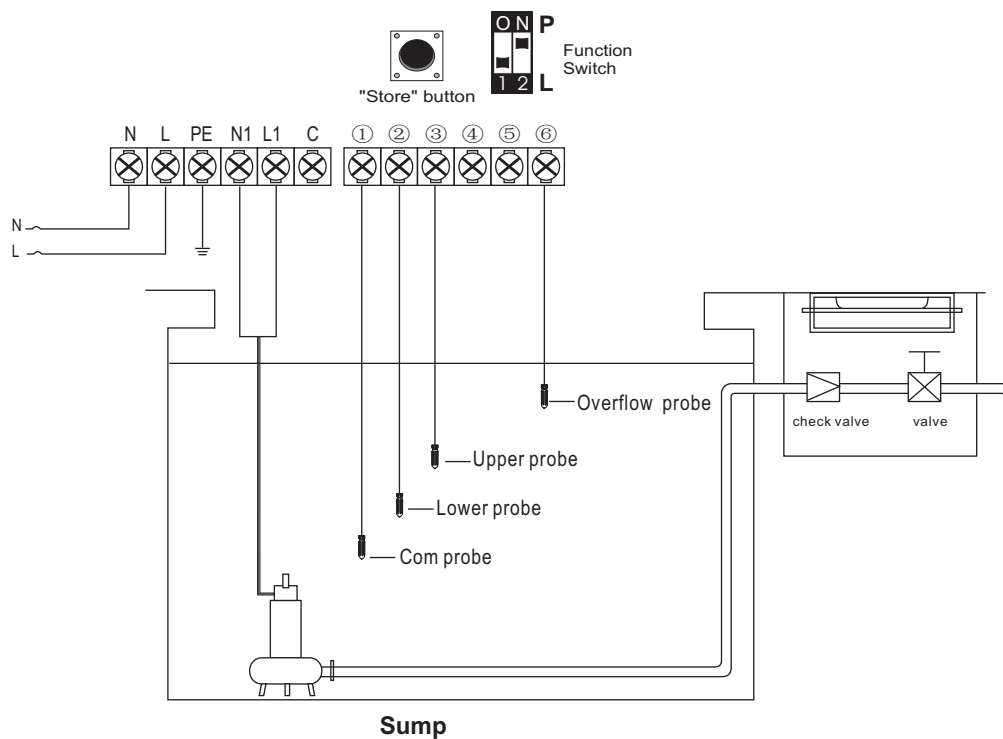

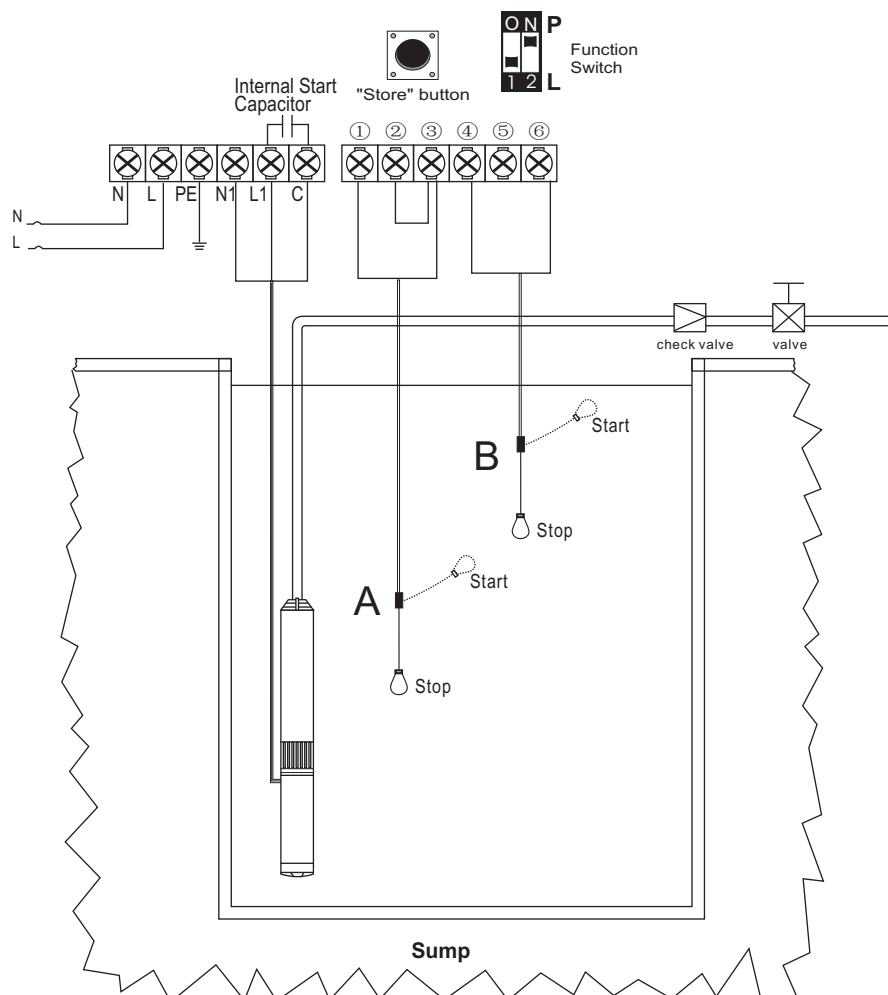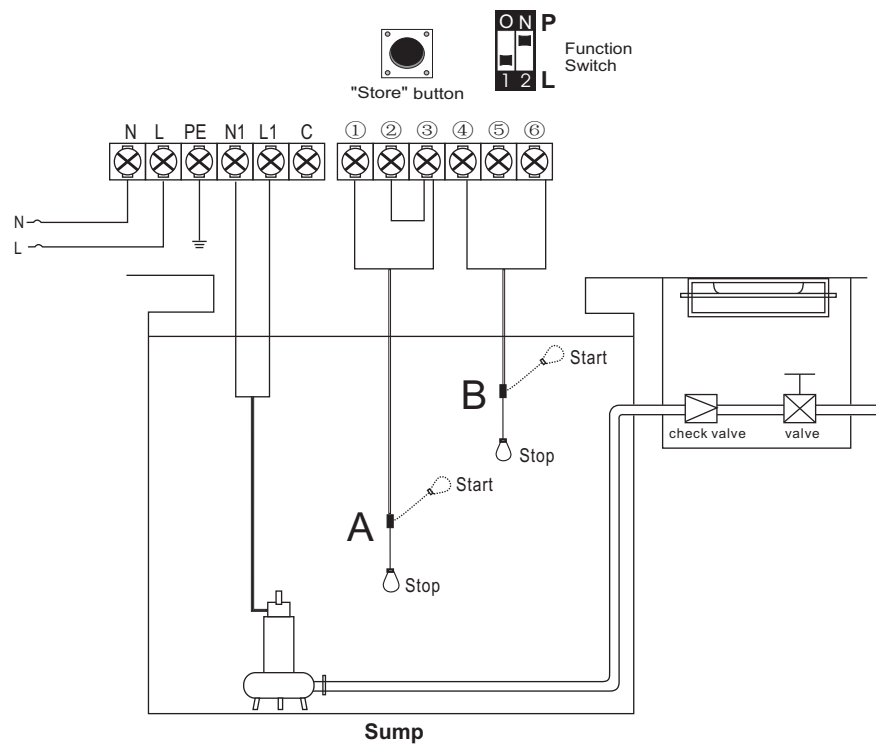

1). Starting condition

liquid level in the sump reaches Upper probe (float switch A: Up level), the product will run pump;

2). Stop condition

liquid level in the sump is below Lower probe (float switch A: Down level), the product will stop pump running;

3). Over Flow alarm

when pump is draining water, liquid level in the sump is still rising to Overflow probe (float switch B: Up level), the product will sound the overflow alarm to warn pump user to take further action.

4). Meaning of the messages & graphic shown on the LCD screen

Message	Description
	Liquid level in the sump reaches Upper probe (Float Switch A: Up level), pump starts running;
	Liquid level in the sump is below the pump intake, pump stops running;
	Liquid level in the sump is below Lower probe (Float Switch A: Down level)
	Liquid level in the sump reaches Overflow probe (Float Switch B: Up level), control panel sends overflow alarming

4 BASIC OPERATION

4.1 Switching to MANUAL mode

Press the **MODE** key to switch to manual state, product is under the manual control state;

under manual state, press the **START** key to run pump; press the **STOP** key to stop pump running;

Note: under manual state, the product can not receive the signal from float switch or pressure switch.

4.2 Switching to AUTO mode

Press the **MODE** key to switch to auto state, product is under the auto control state; under auto state, product will run or stop the pump according to the signal from float switch probe or pressure switch.

Note: under auto state, if the pump is running and pump user wants to stop pump running compulsory, press the **MODE** key to switch to manual state and pump stops running;

Note: under auto state, if the input power being cut off and recovery power again, the product will enter operation state after 10seconds countdown;

Note: no matter the product is under auto or manual state, if the input power being cut off and recovery power again, the product will resume its operation state as the operation state before power being cut off;

4.3 Pump protection

During pump running, if dry run, over load, under voltage, over voltage etc failures happened, the product will immediately shut down the pump running and automatically execute a check for restarting conditions after a built in time delay has elapsed. the product will not recover automatically until all the abnormal situation(s) have been cleared.

5 TROUBLE SHOOTING GUIDE

Fault Message	Possible Cause	Solutions
flashing of UNDER V	the real running voltage is lower than the calibrated voltage, pump is in under voltage protection state	report low line voltage to the power supply company
		product will attempt to restart the pump every 5minutes until line voltage is restored to normal
flashing of OVER V	the real running voltage is higher than the calibrated voltage, pump is in over voltage protection state	report high line voltage to the power supply company
		product will attempt to restart the pump every 5minutes until line voltage is restored to normal
flashing of OVER LOAD	the real running ampere is higher than the calibrated running ampere, pump is in over load protection state	product will attempt to restart the pump every 30minutes until running ampere is restored to normal
	pump impeller is jammed / pump motor dragging / pump bearing broken	check pump impeller or bearing
flashing of NO CALIBR	parameter calibration not completed	refer to parameter calibration setting
flashing of DRY RUN	liquid level in the well / sump is below the pump intake, pump stops running	product will attempt to restart the pump every 30minutes until liquid level above the pump intake
flashing of STALLED	pump motor running ampere increasing was greater than the normal running ampere (calibrated ampere) by more than 200%	cut off power supply & repair or replace pump immediately

C.R.I. PUMPS (PVT) LIMITED

(International Division)

7/46-1, Keeranatham Road, Saravanampatty, Coimbatore - 641 035. India.

Phone : +91-422-3911610, 3911612. Fax : +91-422-3911600, e-mail : cri@crifluidsystems.com website : www.crifluidsystems.com

BOMBAS C.R.I. ESPAÑA, S.L.

Poligono Industrail El.Bony Calle 31, No. 137, 46470
Catarroja (Valencia) Spain.

Tel : +34-96 1842 974, Fax : +34-96 1842 977

e-mail : cri@bombascri.es website : www.bombascri.es

BOMBAS C.R.I. ESPAÑA S.L. UNIPERSONAL

Via Linara 8, 82030, Limatola-BENEVENTO-Italy

Tel : +39. 0823 586 904

e-mail : cri@bombascri.it website:www.crifluidsystems.com

C.R.I. BOMBAS HIDRÁULICAS LTDA

Av. Rodrigo Fernando Grillo, 457, Jd. Manacas,
CEP - 14.801-534, Araraquara - SP, Brasil.

Fone : +55-16-3331 1099, Fax : +55-16-3331 5344

e-mail : cri@cribombas.com.br website : www.cribombas.com.br

Filial : Jaboatão dos Guararapes-PE, Brasil.

Fone : (81) 3093-9620, Fax : (81) 3093-9600.

C.R.I. PUMPS S.A. (PTY) LIMITED

P.O. Box 6292, Halfway House, Midrand - 1685,
Johannesburg, South Africa.

Tel : +27-11-8058631 / 32, Fax : +27-11-8058630

e-mail : cri@cripumps.co.za website : www.cripumps.co.za

Branches : Capetown : + 27-21-9499122

Durban : + 27-31-7001814

C.R.I. POMPA SANAYİ VE TİCARET LİMİTED ŞİRKETİ

10032 Sk. No:12 A.O.S.B. 35620 Çiğli-İzmir-Türkiye.

Tel : +90-232-328-328 22 99, Fax : +90-232-328 23 33

e-mail : cri@cripompa.com website : www.cripompa.com

PT. CRI FLUID SYSTEMS

Kawasan Industri dan Pergudangan Marunda Center

Blok B No: 23 Jalan Marunda Makmur, Segaramakmur, Tarumajaya,

Kab. Bekasi, Jawa Barat 17211, Indonesia, Ph : 021-8899 7558

Email : sales.id@crifluidsystems.com Website : www.crifluidsystems.com

C.R.I. FLUID SYSTEMS USA LLC

4655 Wright Road, Ste. 140, Stafford, TX 77477, USA.

Tel : 832-430-4660 Email : sales@crigroups.us

Website : www.crigroups.us

C.R.I. PUMPS (FZE)

P.O. Box 7988, A4-12 SAIF-Zone, Sharjah, U.A.E.

Tel : +971-6-5573041 (3 Lines), Fax : +971-6-5573042

e-mail : cripumps@eim.ae website : www.cripumps.ae

C.R.I. FLUID SYSTEMS INC.,

Polyland Industrial Subdivision, Warehouse #3, Block 4,

Kendex St., Bo. Iba, Meycauayan, Bulacan. Philippines. Zip-3020.

Phone : +63 44 762 8887 / +63 44 802 6199, Fax : +63 44 762 8883.

e-mail : sales.ph@crigroups.com

Website : www.crifluidsystems.com

C.R.I. FLUID SYSTEMS (BD) LTD.,

Ground Floor, Unit-1 Holding No 212, Tejgaon Industrial Area,

Tejgaon - Gulshan Link Rd, Dhaka - 1208, Bangladesh

Website : www.crifluidsystems.com

C.R.I. PUMPS (Shanghai) Co., Ltd.

Room 902, Building No.7, 1855 Qixin Road,

Minhang District, Shanghai - 201101. China.

Tel : +86-21-54405082, Fax : +86-21-54405083

e-mail : cri@bombascri.com.cn

website : www.bombascri.com.cn

SUZHOU C.R.I. PUMPS CO., LTD.

579, Longqia Road, Wujiang District - 215200

Suzhou, China. Telephone : +86-512-634 33668

Fax : +86-512-634 33667, e-mail : cri@crisuzhou.com.cn

C.R.I. Electronic Pump Control

ELCON PLUS Manual

EPP-5WI

Ver.1.1



Conventions used in this manual

In the manual the following symbols will be used:



Generic danger Failure to comply with the safety regulations that follow can irreparably damage the controller or equipment.



Electric shock risk Failure to comply with the safety regulations that follow can cause death or serious personal injury.

WARNINGS

Read this manual carefully before any operation.
Please keep this manual for future use.




WARNING!!

- Before carrying out any installation or maintenance operation, controller must be disconnected from the power supply;
- Don't open the cover during running the controller;
- Don't put wire ,metal bar filaments etc into the controller;
- Don't splash water or other liquid over the controller;



CAUTION

- The electrical and hydraulic connections must be carried out by competent, skilled.qualified personnel;
- Never connect AC power to output uvw terminals;
- Ensure the motor, controller and power specifications matching;
- Don't install the controller in the following condition;




mechanical shock



corrosive gas or
corrosive liquid



Extreme heat and cold,
acceptable temperature
range: -25°C +55°C



Salt mist corrosion



Rain and Moisture



flammable material:
solvent



TABLE OF CONTENTS

1 INTRODUCTION	. 1.
1.1 Applications	. 1.
1.2 Technical parameter & features	. 1.
1.3 Controller components	. 3.
2 INSTALLATION	. 4.
2.1 Electrical connection to the power supply line and electrical pump	. 4.
2.2 Function switch setting	. 5.
2.3 Parameter Calibration setting & erasing	. 6.
3 ELECTRICAL CONNECTION	. 7.
3.1 Installing float switch	. 7.
3.2 Electrical connection for different application	. 9.
3.2.1 Water supply by liquid level control through float switch or liquid probe	. 9.
3.2.2 Booster by pressure control through pressure switch & pressure tank	. 14.
3.2.3 Drainage by liquid level control through float switch or liquid probe	. 18.
4 BASIC OPERATION	. 21.
4.1 Switching to MANUAL mode	. 21.
4.2 Switching to AUTO mode	. 21.
4.3 Pump protection	. 21.
4.4 Pump last five failure record displaying	. 21.
4.5 Pump accumulative running time displaying	. 22.
5 TROUBLE SHOOTING GUIDE	. 23.

RESPONSIBILITY

The manufacturer is not liable for malfunctioning if the product has not correctly been installed, damaged, modified, and /or run outside the recommended work range or run outside the recommended work range or in contrast with other indications given in this manual.

The manufacturer declines all responsibility for possible errors in this operation manual, if due to misprints or errors in copying.

The manufacturer reserves the right to make any modifications to products that it may consider necessary or useful, without affecting the essential characteristics.

1 INTRODUCTION

Thank you for choosing our products, we will supply you with cordial and well-around service as well as ever.

Intelligent Pump Controller is an easy to use, programmable controlling & protection device for direct start, three phase deep well submersible pump, centrifugal pump, pipeline pump etc.

The product has many operation modes by adopting different electric installations. An important feature that makes the difference between the product and common On/Off pump control box is the float switch free in the well. Our special design makes it a very reliable and sensitive protection against pump dry run without installation float switch in the well.

1.1 Applications

The product is useful in all cases we need to control and protect single pump managing its turn-on and turn off by different electric installations.

Typical usage scenarios include:

- Houses
- Flats
- Holidays houses
- Farms
- Water supply from wells
- Irrigations of greenhouses, gardens, agriculture
- Rain water reuse
- Industrial plants
- Waste water tank / Sewage sink

1.2 Technical parameter & features

Main features:



- Built In function switch
 - applied for water supply by liquid level control through float switch or liquid probe
 - applied for booster by pressure control through pressure switch and pressure tank
 - applied for drainage by liquid level control through float switch or liquid probe
- Automatic stops the pump in the case of water shortage, protecting it from dry running without installing float switch in the well
- Auto / Manual switch
- Dynamic LCD displaying pump running state
- Protect the pump against many faults
- Push Button Calibration
- Starts and stops the pump in accordance with the different liquid level or pressure setting




The following chart shows main technical parameters of The product

Main technical characteristic	
Control characteristic	double liquid level control
	pressure control
Control method	Manual / Auto
Liquid level control characteristic	liquid probe or float switch
Pressure control characteristic	pressure switch (n/c) & pressure tank
Main technical data	
Rated output power	refer to the nameplate
Rated input voltage	refer to the nameplate
Trip response time of over load	5sec-5min
Trip response time of short circuit	<0.1sec
Trip response time of under / over voltage	<5sec
Trip response time of dry run	6sec
Recovery time of over load	30min
Recovery time of under / over voltage	5min
Recovery time of dry run	30min
Trip voltage of over voltage	115% of rated input voltage
Trip voltage of under voltage	80% of rated input voltage
Protection function	Dry run Over load Under voltage Over voltage Pump stalled Short circuit Open phase
Main installation data	
Working temperature	-25°C -- +55°C
Working humidity	20% - 90%RH, no drips concreted
Degree of protection	IP22
Install position	Vertical
Unit dimensions (L x W x H)	17×15.5×8.5cm
Unit weight (net)	905g

1.3 Controller components

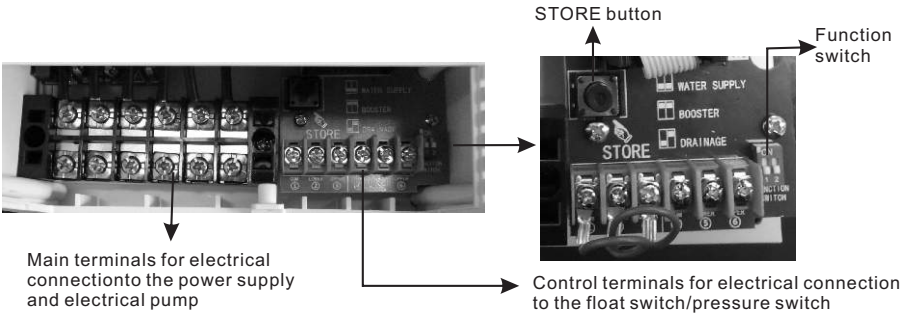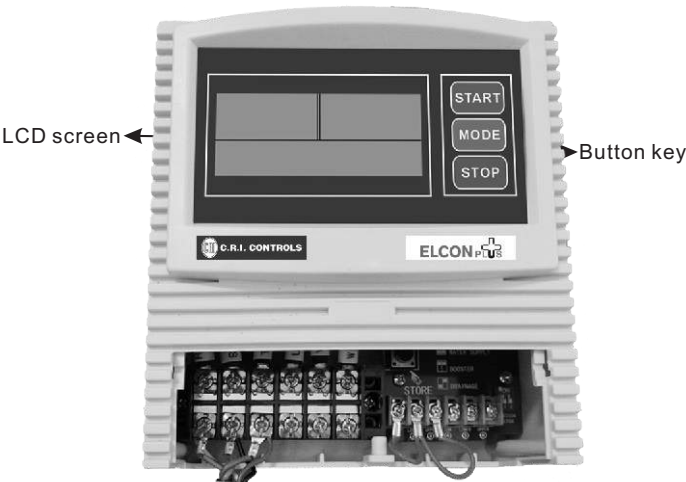

LCD Screen

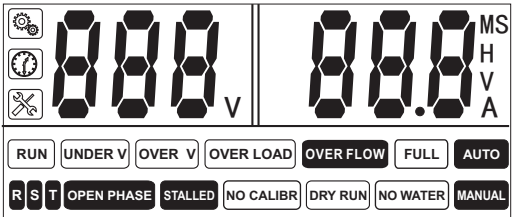


Meaning of the icons shown on the LCD

Icon	Meaning/Description
	pump parameter configuration icon, when this icon appears, pump control box is in parameter adjusting manual;
	time displaying icon, when this icon appears, it means pump control box is displaying some parameter of time, eg: pump dry run triptime (unit:second);
	pump fault icon, when this icon appears, it means pump control box is displaying some fault information;
V	voltage
M	minute
S	second
H	hour
A	ampere

2 INSTALLATION

2.1 Electrical connection to the power supply line and electrical pump

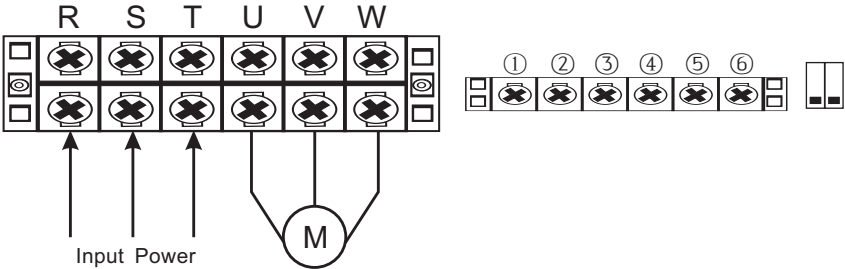


DANGER Electric shock risk

-  Before carrying out any installation or maintenance operation, the product should be disconnected from the power supply and one should wait at least 2 minutes before opening the appliance.
-  Never connect AC power to output U V W terminals.
-  Don't put wire, metal bar filaments etc into the controller.
-  Ensure the motor, controller and power specifications matching.
-  The electrical and hydraulic connections must be carried out by competent, skilled, qualified personnel.

2.2 Function switch setting

Pump users can set the function switch to meet different application requirement, before setting the function switch, the product should be disconnected from the power supply, after complete the setting, apply power to product and observe the application sign displayed on the LCD conforming to the following list.

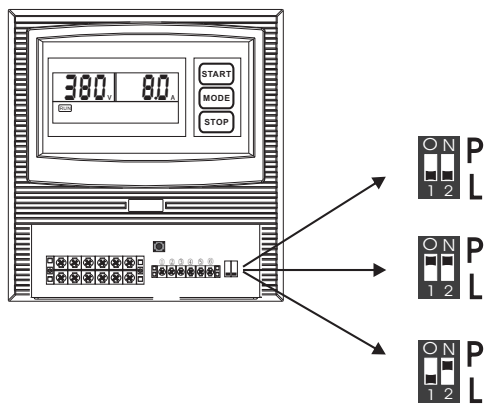

Item	Swith position	Messages & in voltage displaying area	Application
1		000	applied for water supply by liquid level control through liquid probe or float switch
2		222	Applied for booster by pressure control through pressure switch & pressure tank
3		111	Applied for drainage by liquid level control through liquid probe or float switch


2.3 Parameter Calibration setting & erasing

To achieve best level of protection of the pump, it is essential that parameter calibration must be done immediately after successful pump installation or pump maintenance.


Setting the parameter calibration

- Press the **MODE** key to switch to manual state, make sure the pump not running and LCD screen

displaying:

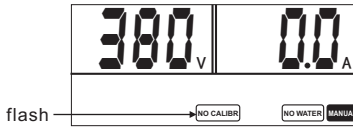


- Press the **START** key to run pump, confirm the pump and all pipe network in normal working state (including voltage, running ampere et); LCD screen displaying:

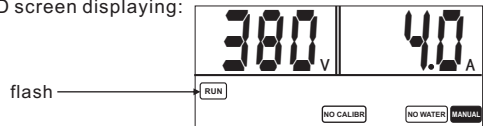

- Press the **STORE** key and release, the product makes a "Di" sound and starts countdown, LCD screen displaying:

product is ready for running.



- Pump stops running and parameter calibration completed, LCD screen displaying:




Erasing former parameter calibration


When pump is reinstalled after maintenance or new pump is installed, user must erase the former parameter calibration and a new calibration must be done.

Erasing the parameter calibration

- Press the **MODE** key to switch to manual state, make sure the pump not running and LCD screen displaying:




- Hold pressing the **STOP** key and release till product makes a "Di" sound, product recover the default factory setting and LCD screen displaying:

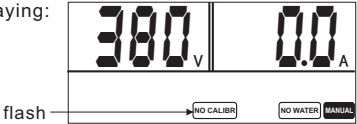

3 ELECTRICAL CONNECTION


3.1 Installing liquid probe & float switch

Liquid probe installation

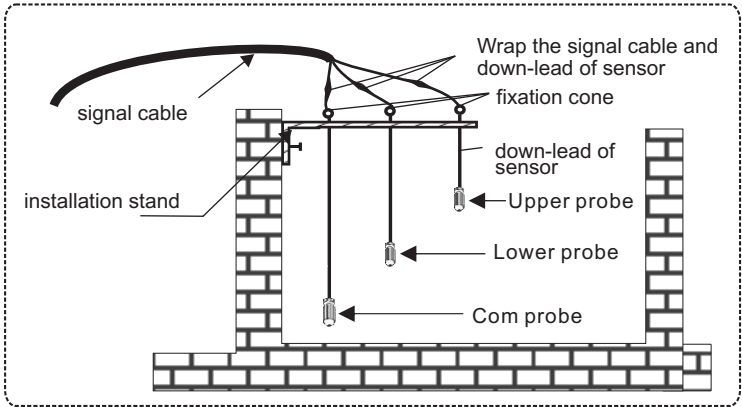

⚠ In event of high risk of electric storms(lightning) or when liquid medium in well or tank or sump is very dirty it is recommended float switch is used.

Float switch installation

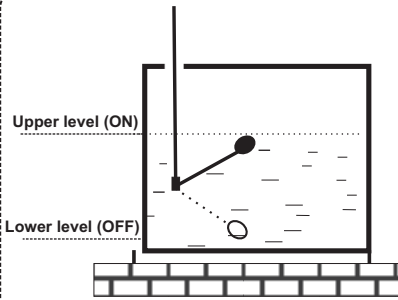


Note

If the float switch is equipped with three wires use the BLACK and BROWN wires. In event of different colors use a multimeter to identify correct connections as follows:



Lower level no reading OFF
Upper level-positive reading-ON



⚠ DO NOT ENCASE SENSOR LEADS, FLOAT SWITCH WIRE OR SIGNAL CABLES IN METAL PIPES. USE PVC OR PE TUBING.


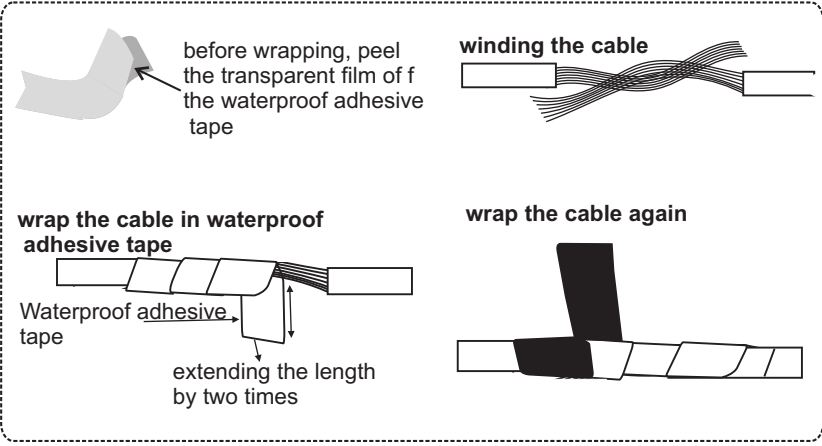




3.2 Electrical connection for different application

3.2.1 Water supply by liquid level control through float switch or liquid probe

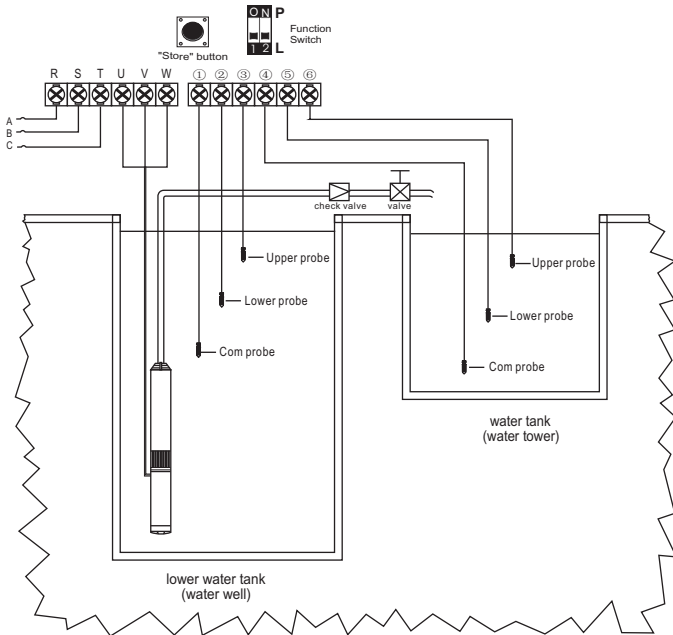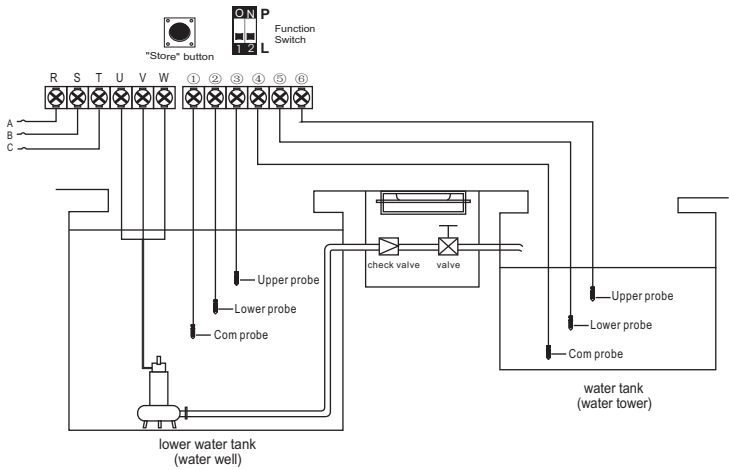

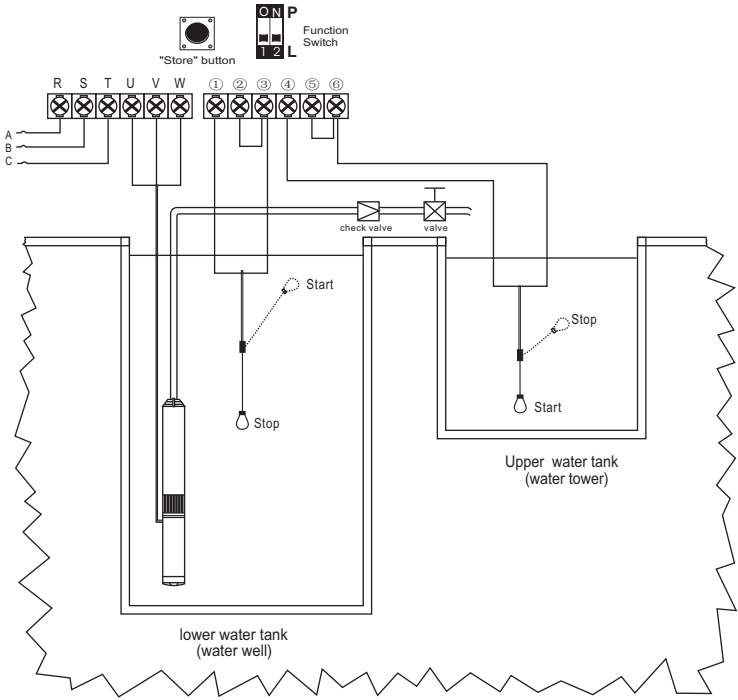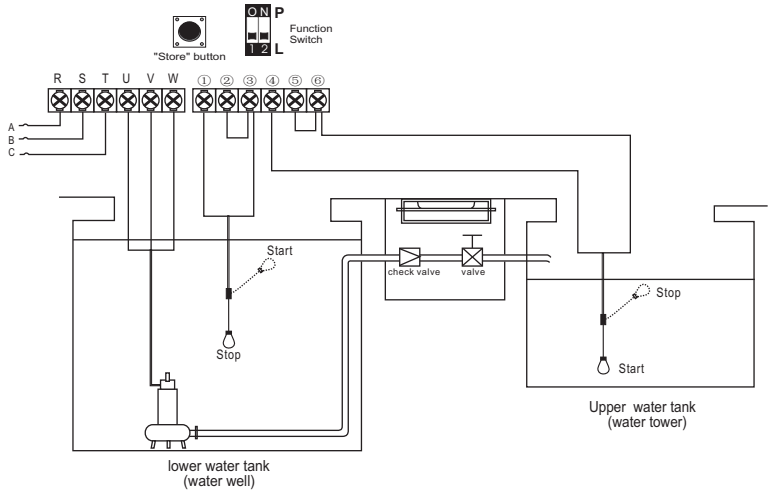

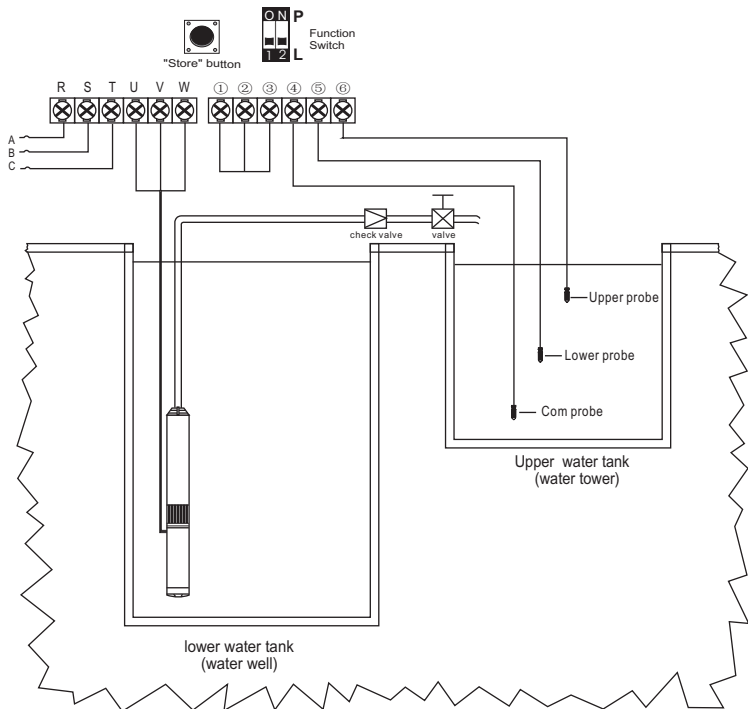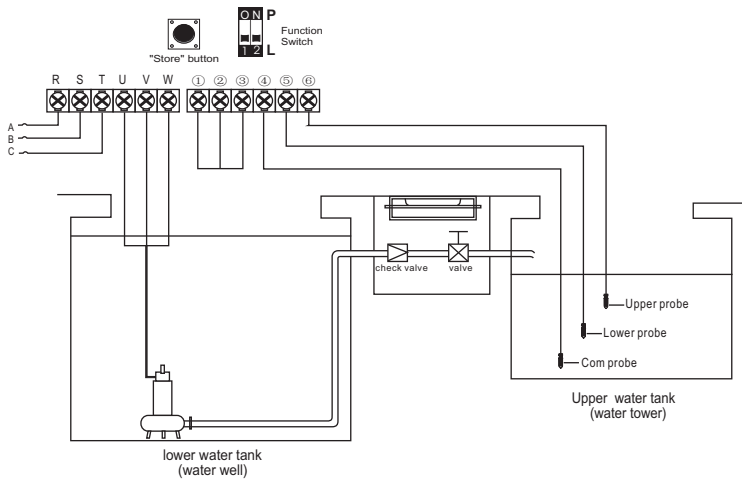

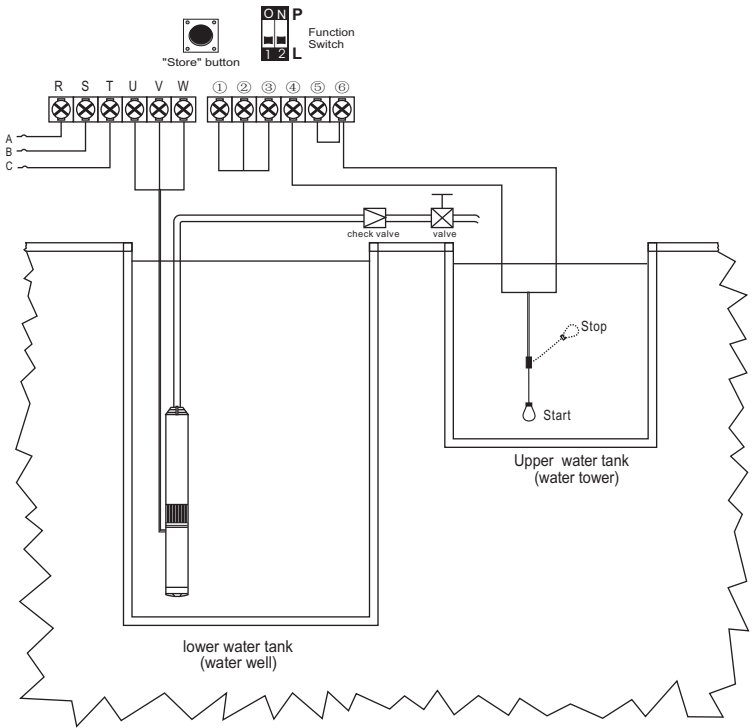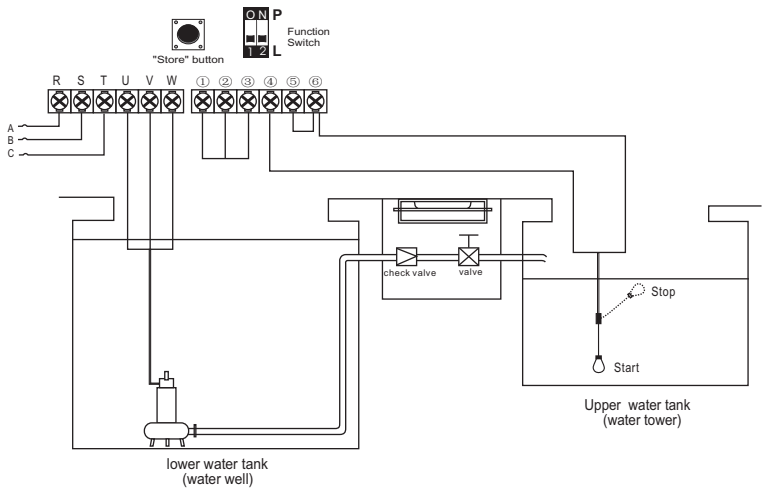

1). Starting condition

liquid level in the water tank is below Lower probe (float switch: Down level) and liquid level in the water well is above Lower probe (float switch: Up level), the product will run pump;

2). Stop condition

liquid level in the water tank reaches Upper probe (float switch: Up level) or liquid level in the water well is below Lower probe (float switch: Down level); the product will stop pump running;



3). The probe / sensor free in the water well



as the product has reliable and automatic stop function against pump dry-run (dewatering), if it is used in submersible pump for deep well, pipeline pump or other situations when it is inconvenient to install lower liquid probe in the well, pump users can put terminals ①、②、③ in short circuit, which minimize the troubles and costs.



4). Meaning of the messages & graphic shown on the LCD screen

Message	Description
FULL	Liquid level in the upper water tank / water tower reaches Upper probe (Float Switch: Up level), pump stops running;
DRY RUN	Liquid level in the well is below the pump intake, pump stops running;
NO WATER	liquid level in the lower water tank / water well is below Lower sensor/ probe (float switch: Down level)

3.2.2 Booster by pressure control through pressure switch & pressure tank

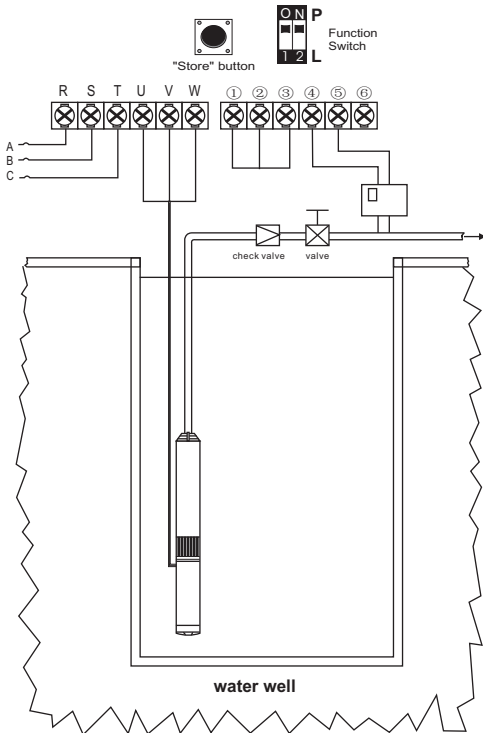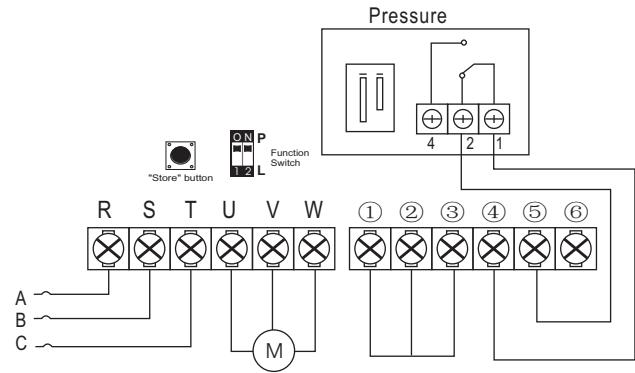

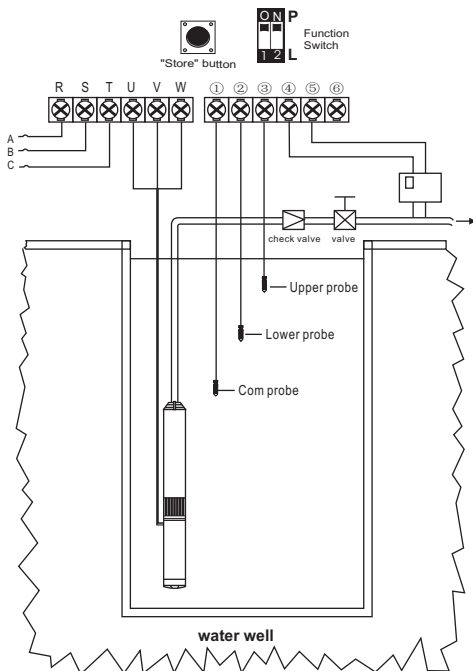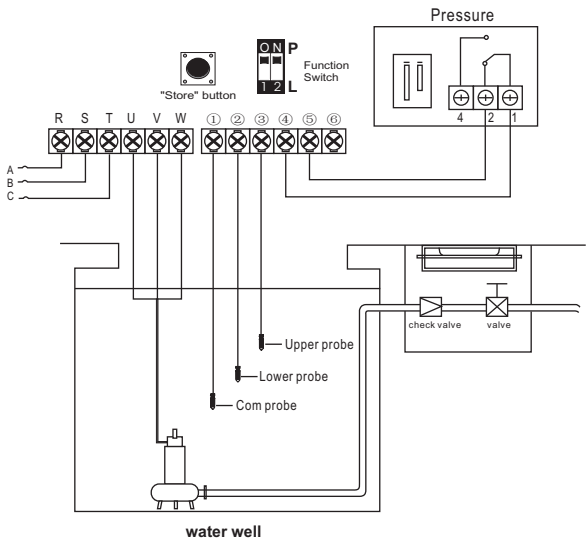

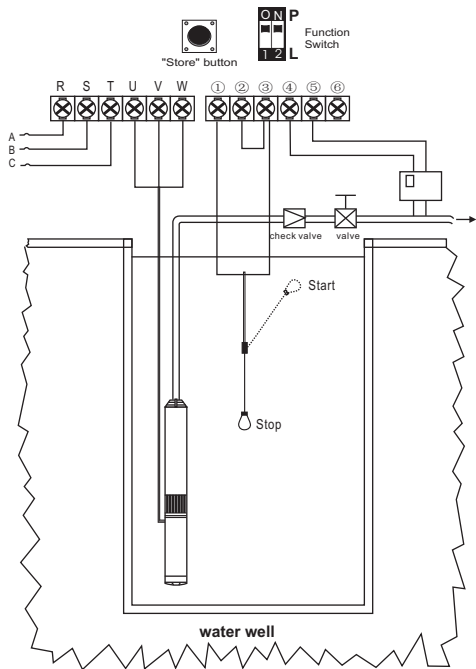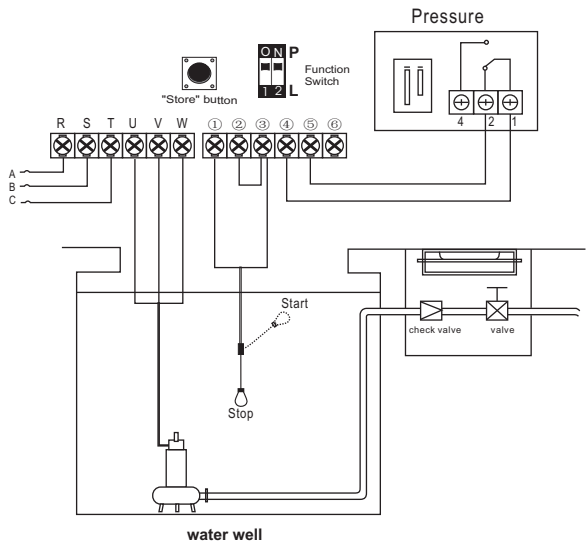

1). Starting condition

there is no pressure in the pipeline or pressure tank, contacting point of pressure switch is ON and liquid level in the water well is above Lower probe (float switch: Up level), the product will run pump;

2). Stop condition

there is full pressure in the pipeline or pressure tank, contacting point of pressure switch is OFF, the product1 will stop pump running;

Note: pressure switch with N/C (normal close) contacting point:
no pressure, contacting point is ON; meet the pressure setting, contacting point is OFF



3). The probe / sensor free in the water well



as the product has reliable and automatic stop function against pump dry-run (dewatering), if it is used in submersible pump for deep well, pipeline pump or other situations when it is inconvenient to install lower liquid probe in the well, pump users can put terminals ①、②、③in short circuit, which minimize the troubles and costs.

4). Meaning of the messages & graphic shown on the LCD screen

Message	Description
FULL	There is full pressure in the pipeline or pressure tank, contacting point of pressure switch is OFF, pump stops running;
DRY RUN	Liquid level in the well is below the pump intake, pump stops running;
NO WATER	liquid level in the lower water tank / water well is below Lower sensor/ probe (float switch: Down level)

3.2.3 Drainage by liquid level control through float switch or liquid probe

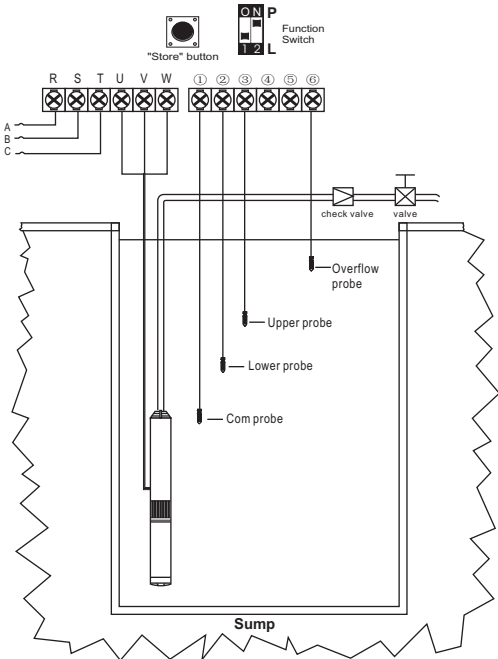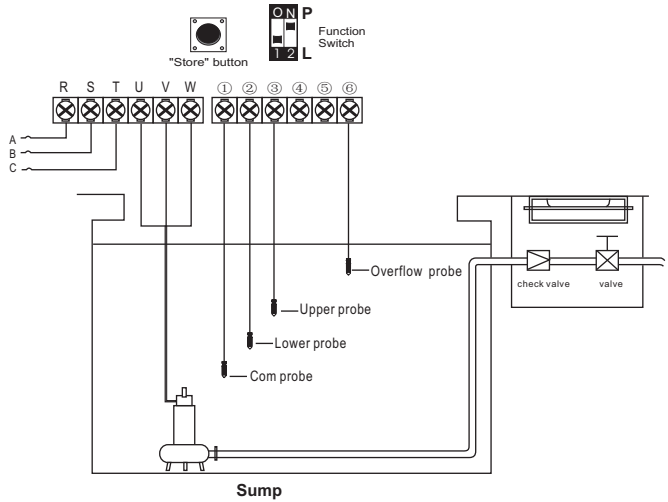

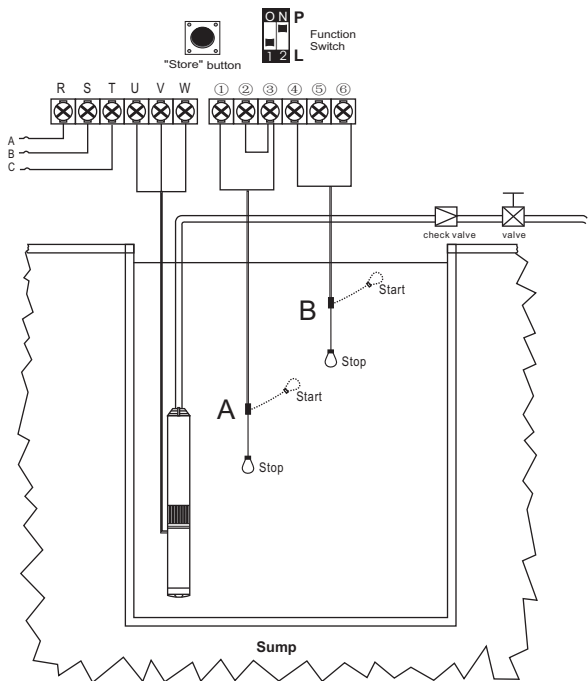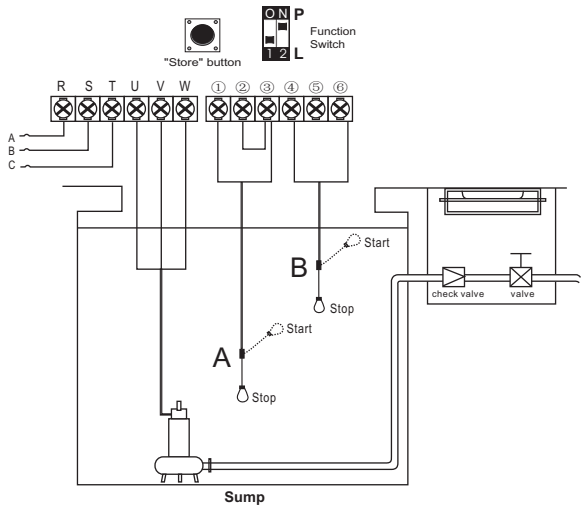

1). Starting condition

liquid level in the sump reaches Upper probe (float switch A: Up level), the product will run pump;

2). Stop condition

liquid level in the sump is below Lower probe (float switch A: Down level), the product will stop pump running;

3). Over Flow alarm

when pump is draining water, liquid level in the sump is still rising to Overflow probe (float switch B: Up level), the product will sound the overflow alarm to warn pump user to take further action.

4). Meaning of the messages & graphic shown on the LCD screen

Message	Description
	Liquid level in the sump reaches Upper probe (Float Switch A: Up level), pump starts running;
	Liquid level in the sump is below the pump intake, pump stops running;
	Liquid level in the sump is below Lower probe (Float Switch A: Down level)
	Liquid level in the sump reaches Overflow probe (Float Switch B: Up level), control panel sends overflow alarming

4 BASIC OPERATION

4.1 Switching to MANUAL mode

Press the **MODE** key to switch to manual state, product is under the manual control state;
under manual state, press the **START** key to run pump; press the **STOP** key to stop pump running;

Note: under manual state, the product can not receive the signal from float switch or pressure switch.

4.2 Switching to AUTO mode

Press the **MODE** key to switch to auto state, product is under the auto control state; under auto state, product will run or stop the pump according to the signal from float switch probe or pressure switch.

Note: under auto state, if the pump is running and pump user wants to stop pump running compulsory, press the **MODE** key to switch to manual state and pump stops running;

Note: under auto state, if the input power being cut off and recovery power again, the product will enter operation state after 10seconds countdown;

Note: no matter the product is under auto or manual state, if the input power being cut off and recovery power again, the product will resume its operation state as the operation state before power being cut off;

4.3 Pump protection


During pump running, if dry run, over load, under voltage, over voltage etc failures happened, the product will immediately shut down the pump running and automatically execute a check for restarting conditions after a built in time delay has elapsed. the product will not recover automatically until all the abnormal situation(s) have been cleared.

4.4 Pump last five failure record displaying


The controller can memorize the last five failures of pump, so it is very convenient for the pump users to analyse the pump running conditions.

Displaying the pump last five failure record

- Press the **MODE** key to switch to manual state, make sure the pump not running and LCD screen displaying:



- Hold pressing **STOP** key and press **MODE** key, the controller makes a "Di" sound, Controller displays pump failure record;
- Press **STOP** key to quit the failure record displaying;

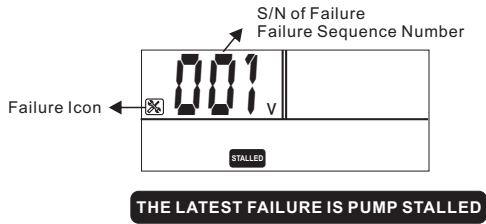

4.5 Pump accumulative running time displaying


The controller can memorize how many hours of pump running, so it is very convenient for the pump users to analyse the pump running conditions and do maintenance

Displaying the pump accumulative running time

- Press the **MODE** key to switch to manual state, make sure the pump not running and LCD screen displaying:



- Hold pressing **STORE** button and press **STOP** key, the controlle makes a "Di" sound, controlle displays pump failure record;

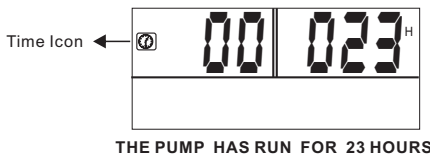

- Press **STOP** key to quit the accumulative running time displaying;

5 TROUBLE SHOOTING GUIDE

Fault Message	Possible Cause	Solutions
flashing of UNDER V	the real running voltage is lower than the calibrated voltage, pump is in under voltage protection state	report low line voltage to the power supply company
		product will attempt to restart the pump every 5minutes until line voltage is restored to normal
flashing of OVER V	the real running voltage is higher than the calibrated voltage, pump is in over voltage protection state	report high line voltage to the power supply company
		product will attempt to restart the pump every 5minutes until line voltage is restored to normal
flashing of OVER LOAD	the real running ampere is higher than the calibrated running ampere, pump is in over load protection state	product will attempt to restart the pump every 30minutes until running ampere is restored to normal
	pump impeller is jammed / pump motor dragging / pump bearing broken	check pump impeller or bearing
flashing of NO CALIBR	parameter calibration not completed	refer to parameter calibration setting
flashing of DRY RUN	liquid level in the well / sump is below the pump intake, pump stops running	product will attempt to restart the pump every 30minutes until liquid level above the pump intake
flashing of STALLED	pump motor running ampere increasing was greater than the normal running ampere (calibrated ampere) by more than 200%	cut off power supply & repair or replace pump immediately
flashing of OPEN PHASE	power supply lose phase	report to the power supply company
	controller inlet wire or pump cable broken	repair inlet wire or pump cable

C.R.I. PUMPS (PVT) LIMITED

(International Division)

7/46-1, Keeranatham Road, Saravanampatty, Coimbatore - 641 035, India.

Phone : +91-422-3911610, 3911612. Fax : +91-422-3911600, e-mail : cri@crifluidsystems.com website : www.crifluidsystems.com

BOMBAS C.R.I. ESPAÑA, S.L.

Poligono Industrial El Bony Calle 31, No. 137, 46470

Catarroja (Valencia) Spain.

Tel : +34-96 1842 974, Fax : +34-96 1842 977

e-mail : cri@bombascri.es website : www.bombascri.es

BOMBAS C.R.I. ESPAÑA S.L. UNIPERSONAL

Via Linara 8, 82030, Limatola - BENEVENTO - Italy

Tel : +39. 0823 586 904

e-mail : cri@bombascri.it website : www.crifluidsystems.com

C.R.I. BOMBAS HIDRÁULICAS LTDA

Av. Rodrigo Fernando Grillo, 457, Jd. Manacas,

CEP - 14.801-534, Araraquara - SP, Brasil.

Fone : +55-16-3331 1099, Fax : +55-16-3331 5344

e-mail : cri@cribombas.com.br website : www.cribombas.com.br

Filial : Jaboatão dos Guararapes-PE, Brasil.

Fone : (81) 3093-9620, Fax : (81) 3093-9600.

C.R.I. PUMPS S.A. (PTY) LIMITED

P.O. Box 6292, Halfway House, Midrand - 1685,

Johannesburg, South Africa.

Tel : +27-11-8058631 / 32. Fax : +27-11-8058630

e-mail : cri@cripumps.co.za website : www.cripumps.co.za

Branches : Capetown : + 27-21-9499122

Durban : + 27-31-7001814

C.R.I. POMPA SANAYI VE TICARET LIMITED S İRKETİ

10032 Sk. No:12 A.O.S.B. 35620 Çiğli-Izmir-Türkiye.

Tel : +90-232-328-328 22 99, Fax : +90-232-328 23 33

e-mail : cri@cripompa.com website : www.cripompa.com

PT. CRI FLUID SYSTEMS

Kawasan Industri dan Pergudangan Marunda Center

Blok B No: 23 Jalan Marunda Makmur, Segaramakmur, Tarumajaya,

Kab. Bekasi, Jawa Barat 17211, Indonesia, Ph : 021-8899 7558

Email : sales.id@crifluidsystems.com Website : www.crifluidsystems.com

C.R.I. FLUID SYSTEMS USA LLC

4655 Wright Road, Ste. 140, Stafford, TX 77477, USA.

Tel : 832-430-4660 Email : sales@crigroups.us

Website : www.crigroups.us

C.R.I. PUMPS (FZE)

P.O. Box 7988, A4-12 SAIF-Zone, Sharjah, U.A.E.

Tel : +971-6-5573041 (3 Lines), Fax : +971-6-5573042

e-mail : cripumps@eim.ae website : www.cripumps.ae

C.R.I. FLUID SYSTEMS INC.,

Polyland Industrial Subdivision, Warehouse #3, Block 4,

Kendex St., Bo. Iba, Meycauayan, Bulacan, Philippines. Zip-3020.

Phone : +63 44 762 8887 / +63 44 802 6199, Fax : +63 44 762 8883.

e-mail : sales.ph@crigroups.com

Website : www.crifluidsystems.com

C.R.I. FLUID SYSTEMS (BD) LTD.,

Ground Floor, Unit-1 Holding No 212, Tejgaon Industrial Area,

Tejgaon - Gulshan Link Rd, Dhaka - 1208, Bangladesh

Website : www.crifluidsystems.com

C.R.I. PUMPS (Shanghai) Co., Ltd.

Room 902, Building No.7, 1855 Qixun Road,

Minhang District, Shanghai - 201101, China.

Tel : +86-21-54405082, Fax : +86-21-54405083

e-mail : cri@bombascri.com.cn

website : www.bombascri.com.cn

SUZHOU C.R.I. PUMPS CO., LTD.

579, Longqia Road, Wujiang District - 215200

Suzhou, China. Telephone : +86-512-634 33668

Fax : +86-512-634 33667, e-mail : cri@crisuzhou.com.cn

Installation & Operation Manual

Ver. 2.0



Conventions used in this manual

In the manual the following symbols will be used:



Generic danger Failure to comply with the safety regulations that follow can irreparably damage the controller or equipment.



Electric shock risk Failure to comply with the safety regulations that follow can cause death or serious personal injury.

WARNINGS

Read this manual carefully before any operation.

Please keep this manual for future use.




WARNING!!

- Before carrying out any installation or maintenance operation, protector must be disconnected from the power supply;
- Don't open the cover during running the protector;
- Don't put wire, metal bar filaments etc into the protector;
- Don't splash water or other liquid over the protector;




CAUTION

- The electrical and hydraulic connections must be carried out by competent, skilled, qualified personnel;
- Never connect AC power to output C/M/A terminals;
- Ensure the motor, protector and power specifications matching;
- Don't install the protector in the following condition;




mechanical shock



corrosive gas or
corrosive liquid



Extreme heat and cold,
acceptable temperature
range: -25°C +55°C



Salt mist corrosion



flammable material:
solvent

TABLE OF CONTENTS

1 INTRODUCTION 1.

1.1 Applications 1.

1.2 Technical parameter & features 1.

1.3 Controller components..... 3.

2 INSTALLATION..... 4.

2.1 Electrical connection to the power supply line and electrical pump 4.

2.2 Installation of liquid probe & float switch 5.

2.3 Function switch setting..... 6.

2.4 Parameter Calibration setting & erasing 7.

3 ELECTRICAL CONNECTION 9.

3.1 Electrical connection for different application 9.

3.1.1 Water supply by liquid level control through float switch or liquid probe 9.

3.1.2 Booster by pressure control through pressure switch & pressure tank 11.

3.1.3 Drainage by liquid level control through float switch & liquid probe 14.

4 BASIC OPERATION..... 16.

4.1 Switching to MANUAL mode..... 16.

4.2 Switching to AUTO mode 16.

4.3 Pump protection..... 16.

5 TROUBLE SHOOTING GUIDE 17.

RESPONSIBILITY

The manufacturer is not liable for malfunctioning if the product has not correctly been installed, damaged, modified, and /or run outside the recommended work range or run outside the recommended work range or in contrast with other indications given in this manual.

The manufacturer declines all responsibility for possible errors in this operation manual, if due to misprints or errors in copying.

The manufacturer reserves the right to make any modifications to products that it may consider necessary or useful, without affecting the essential characteristics.

1 INTRODUCTION

Thank you for choosing our products, we will supply you with cordial and well-around service as well as ever.

Intelligent Pump Controller is an easy to use, programmable controlling & protection device for direct start, single phase deep well submersible pump, centrifugal pump, pipeline pump motor etc.

1.1 Applications

The product is useful in all cases we need to protect single pump managing its turn-on and turn off.

Typical usage scenarios include:

- Houses
- Flats
- Holidays houses
- Farms
- Water supply from wells
- Irrigations of greenhouses, gardens, agriculture
- Rain water reuse
- Industrial plants
- Waste water tank / Sewage sink

1.2 Technical parameter & features

Main features:

- Dynamic LCD displaying pump running state
- Protect the pump against many faults
- Memory Function when Power Off&Power Recovery
- Visual &Audio Alarm For Fault Prompt
- Push Button Calibration
- Reserved space for installing internal start capacitor
- IP54 protection grade

The following chart shows main technical parameters of the product

Main technical data	
Rated output power	refer to the nameplate
Rated input voltage	refer to the nameplate
Trip response time of over load	5sec-5min
Trip response time of short circuit	≤0.1sec
Trip response time of under / over voltage	≤5sec
Trip response time of dry run	6sec
Recovery time of over load	30min
Recovery time of under / over voltage	5min
Recovery time of dry run	30min
Trip voltage of over voltage	115% of rated input voltage
Trip voltage of under voltage	80% of rated input voltage
Protection function	Dry run Over load Under voltage Over voltage Pump stalled Short circuit
Main installation data	
Working temperature	-25℃ -- +55℃
Working humidity	20% - 90%RH, no drips concentered
Degree of protection	IP54
Install position	Wall mounting
Unit dimensions (L x W x H)	152×125×70mm
Unit weight (net)	380g


1.3 Controller components



The picture is for reference only.
Please refer to the object.

NOTE:Start Capacitor not included - optional

LCD Screen

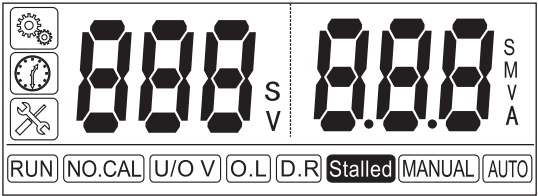


Meaning of the icons shown on the LCD

Icon	Meaning/Description
V	voltage
M	minute
S	second
H	hour
A	ampere
O.L	over load
NO.CAL	pump no calibration
U/O V	under voltage or over voltage
D.R	dry run
Stalled	pump stalled
Manual	in manual state
Auto	in auto state

2 INSTALLATION

2.1 Electrical connection to the power supply line and electrical pump

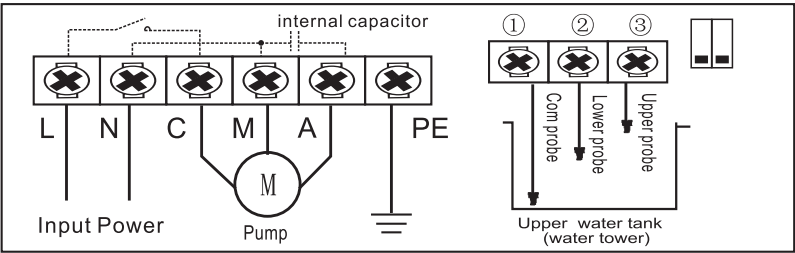


DANGER Electric shock risk

- ⚠ Before carrying out any installation or maintenance operation, the product should be disconnected from the power supply and one should wait at least 2 minutes before opening the appliance.
- ⚠ Never connect AC power to output C/M/A terminals.
- ⚠ Don't put wire, metal bar filaments etc into the controller.
- ⚠ Ensure the motor, protector and power specifications matching.
- ⚠ The electrical and hydraulic connections must be carried out by competent, skilled, qualified personnel.

2.2 Installation of liquid probe & float switch


Liquid probe installation

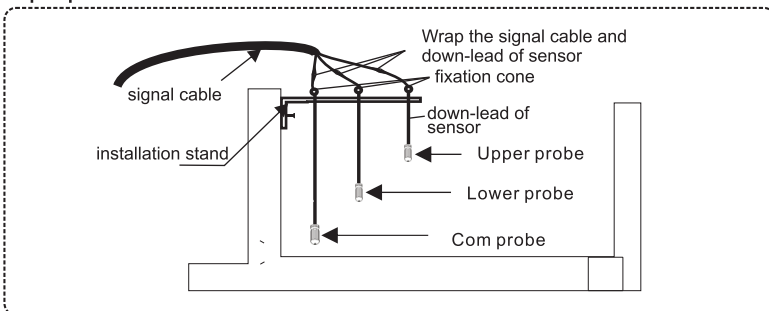


Installing a float switch

Follow the float switch supplier's installation and connection instructions.

Float switch installation

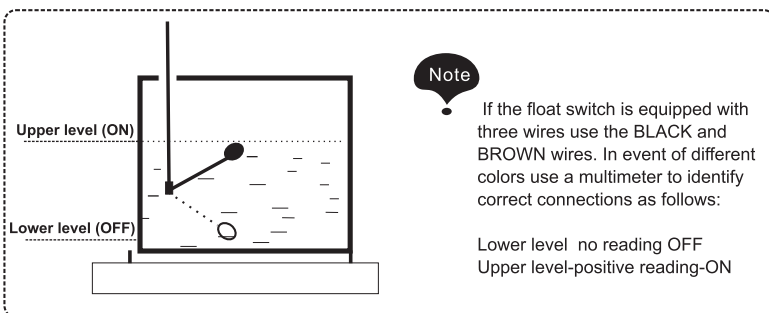


! DO NOT ENCASE SENSOR LEADS, FLOAT SWITCH WIRE OR SIGNAL CABLES IN METAL PIPES. USE PVC OR PE TUBING.

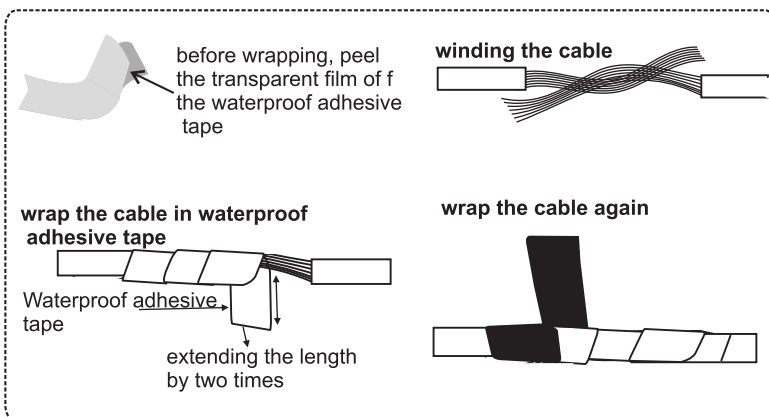

2.3 Function switch setting

Pump users can set the function switch to meet different application requirement, before setting the function switch, the controller should be disconnected from the power supply, after completing the conforming setting, apply power to controller and observe the application sign displayed on the LCD to the following list.

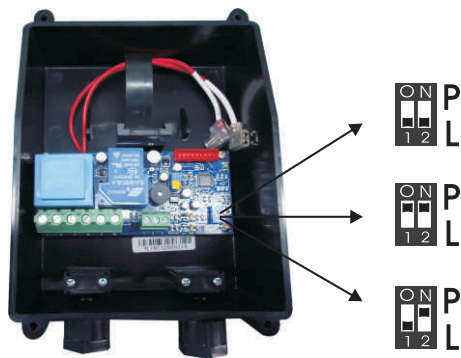


Item	Switch position	Messages & in voltage displaying area	Application
1	ON P L 1 2	000	Applied for water supply by liquid level control through float switch
2	ON P L 1 2	222	Applied for booster by pressure control through pressure switch & pressure tank
3	ON P L 1 2	111	Applied for drainage by liquid level control through float switch

2.4 **Parameter Calibration setting & erasing**


To achieve best level of protection of the motor, it is essential that parameter calibration must be done immediately after successful pump installation or pump maintenance.

Setting the parameter calibration


- Make sure the pump not running and LCD screen displaying:

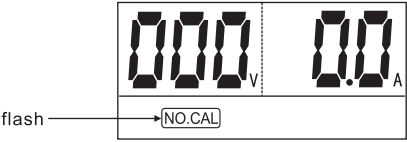

- Press the **START** key to run pump, confirm the pump and all pipe network in normal working state (including voltage, running ampere etc); LCD screen displaying:

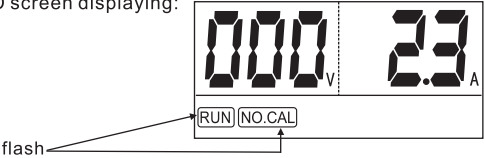


- Hold Press the **START** key and release, the product makes a "Di" sound and starts countdown, LCD screen displaying:



- Pump stops running and parameter calibration completed, LCD screen displaying:

product is ready for running.




Erasing former parameter calibration


When pump is reinstalled after maintenance or new pump is installed, user must erase the former parameter calibration and a new calibration must be done.

Erasing the parameter calibration

- Make sure the pump not running and LCD screen displaying:




- Hold pressing the **STOP** key and release till product makes a "Di" sound, product recover the default factory setting and LCD screen displaying:


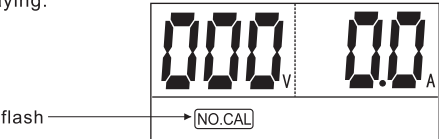


3 ELECTRICAL CONNECTION

3.1 Electrical connection for different application

3.1.1 Water supply by liquid level control through float switch or liquid probe

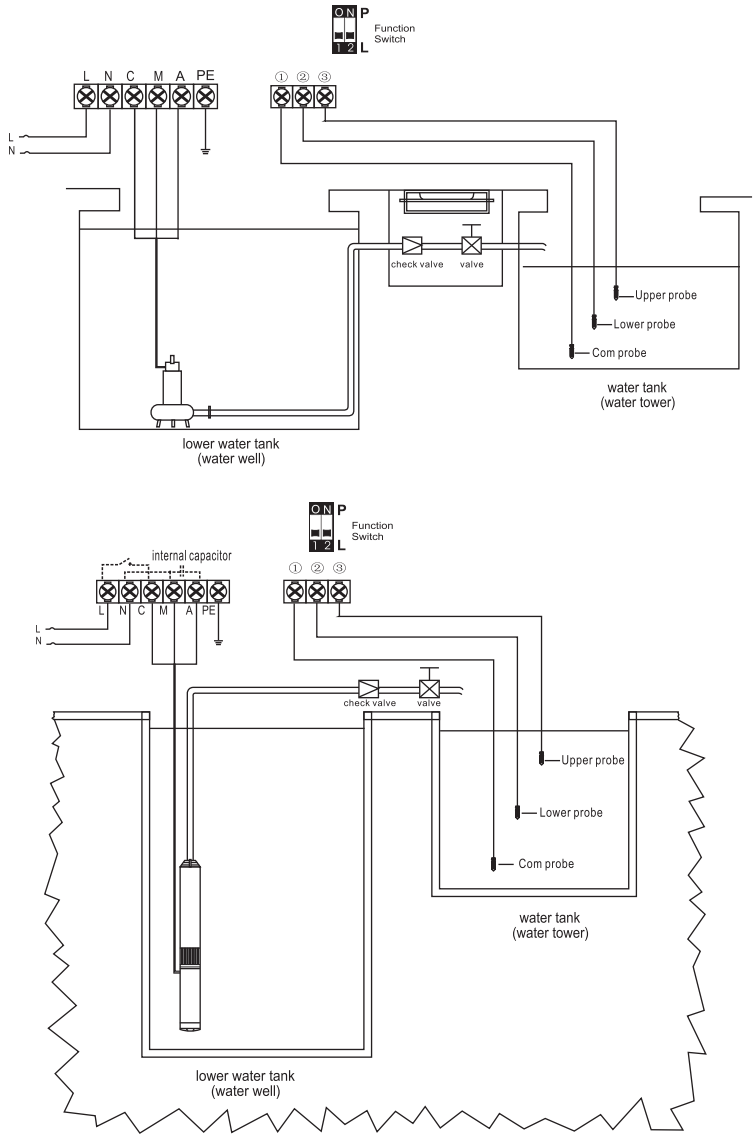

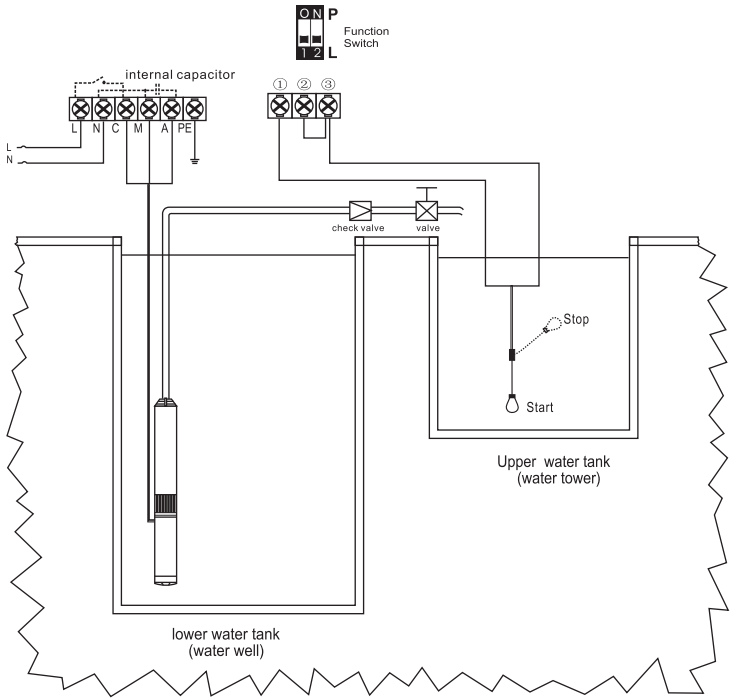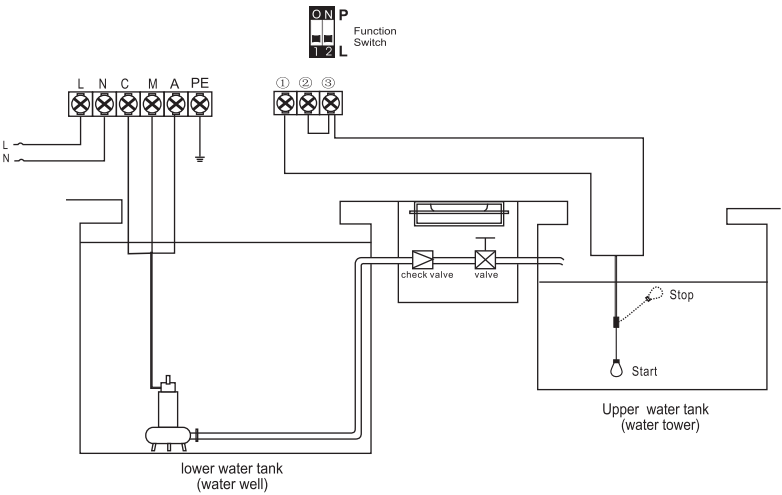




1). Starting condition

liquid level in the water tank is below Lower probe (float switch: Down level) and liquid level in the water well is above Lower probe (float switch: Up level), the controller will run pump;

2). Stop condition

liquid level in the water tank reaches Upper probe (float switch: Up level) or liquid level in the water well is below Lower probe (float switch: Down level); the controller will stop pump running;

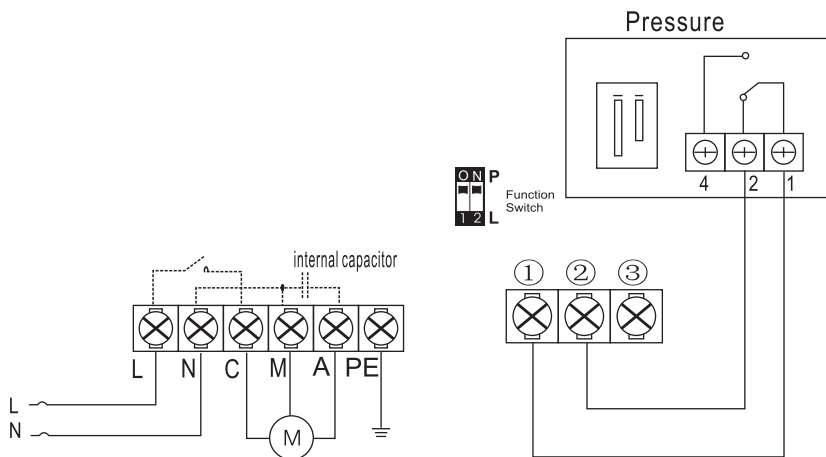3.1.2 Booster by pressure control through pressure switch & pressure tank

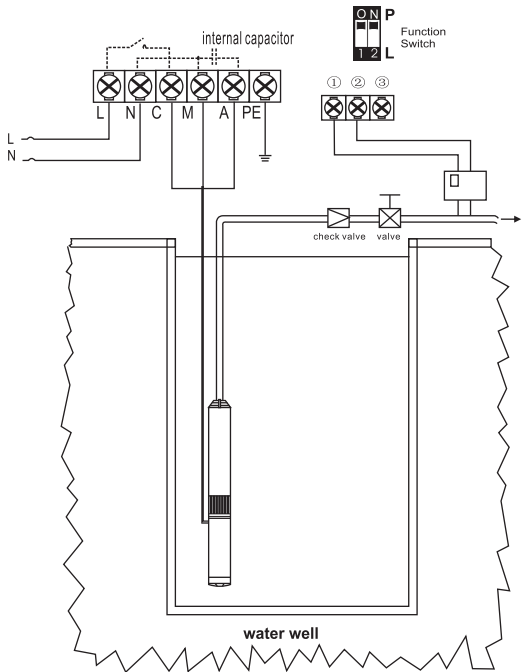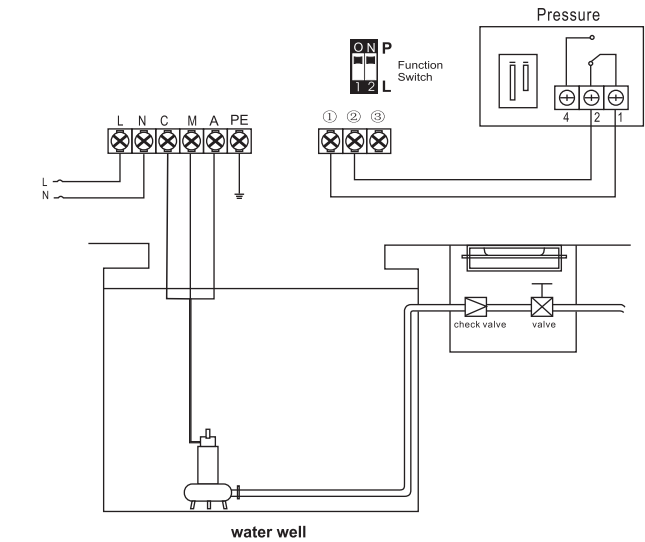

1). Starting condition

There is no pressure in the pipeline or pressure tank, contacting point of pressure switch is ON and liquid level in the water well is above Lower probe (float switch: Up level), the controller will run pump;


2). Stop condition



There is full pressure in the pipeline or pressure tank, contacting point of pressure switch is OFF, the controller will stop pump running;

Note: pressure switch with N/C (normal close) contacting point:

no pressure, contacting point is ON; meet the pressure setting, contacting point is OFF

3.1.3 Drainage by liquid level control through float switch & liquid probe

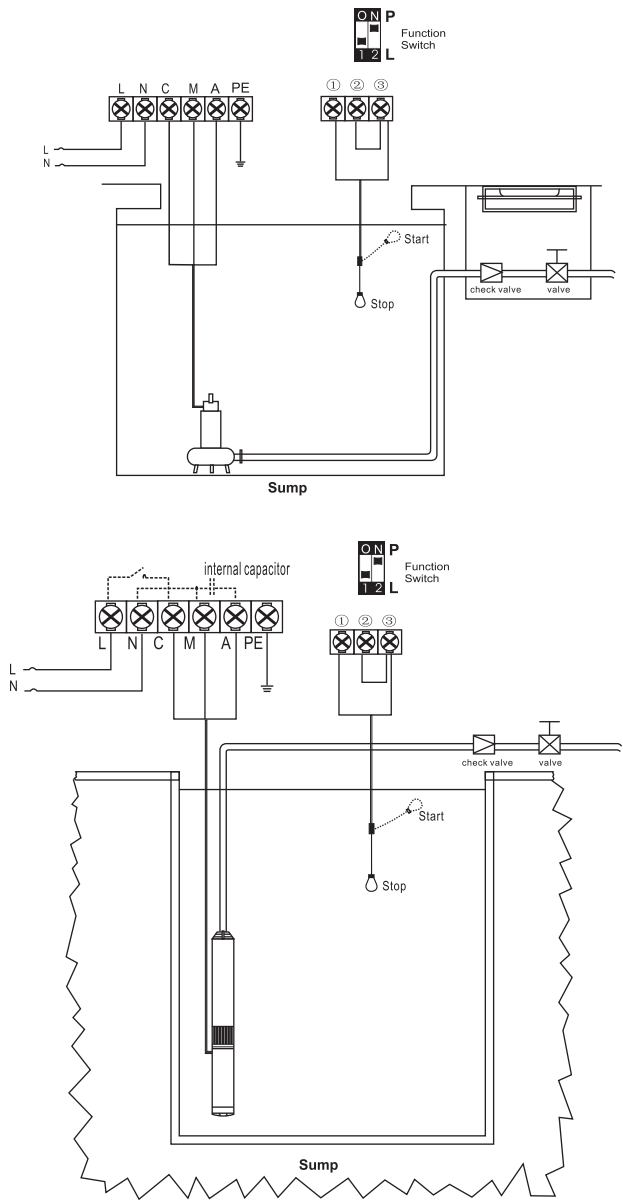

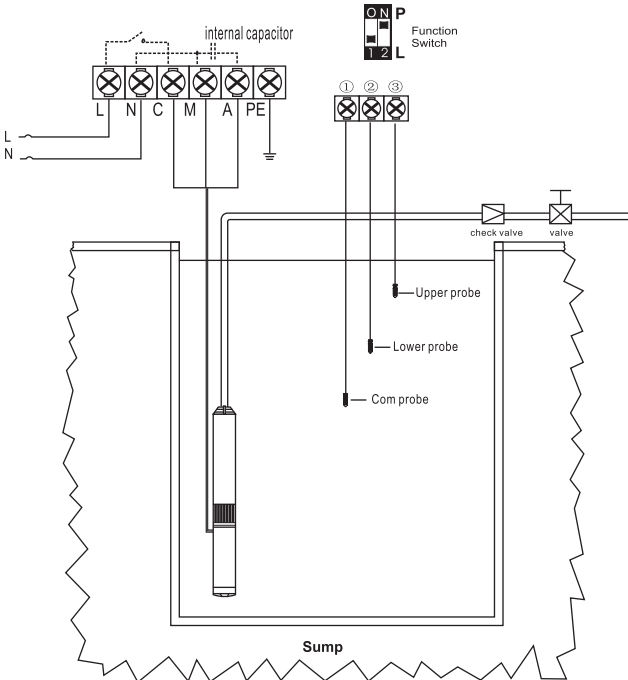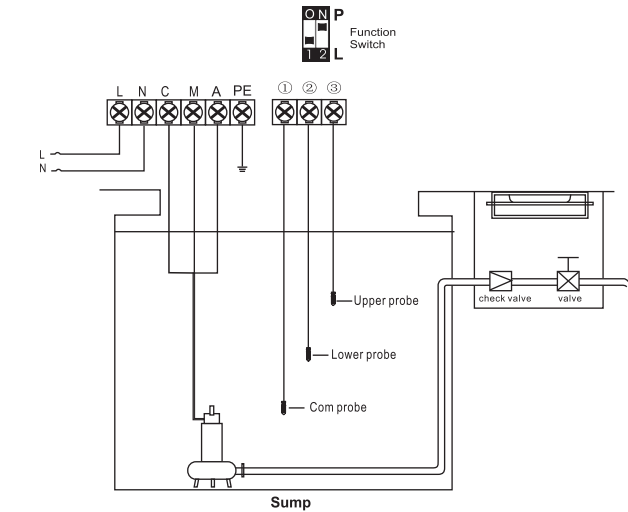

1). Starting condition

liquid level in the sump reaches Upper probe (float switch A: Up level), the controller will run pump;

2). Stop condition

liquid level in the sump is below Lower probe (float switch A: Down level), the controller will stop pump running;

4 BASIC OPERATION

4.1 Switching to MANUAL mode

Press the **MODE** key to switch to manual state, the controller is under the manual control state;

under manual state, press the **START** key to run pump; press the **STOP** key to stop pump running;

Note: under manual state, the controller can not receive the signal from float switch or pressure switch.

4.2 Switching to AUTO mode

Press the **MODE** key to switch to auto state, the controller is under the auto control state; under auto state, the controller will run or stop the pump according to the signal from float switch or pressure switch.

Note: under auto state, if the pump is running and pump user wants to stop pump running compulsory, press the **MODE** key to switch to manual state and pump stops running;

Note: under auto state, if the input power being cut off and recovery power again, the controller will enter operation state after 10seconds countdown;

Note: no matter the controller is under auto or manual state, if the input power being cut off and recovery power again, the controller will resume its operation state as the operation state before power being cut off;

4.3 Pump protection

During pump running, if dry run, over load, under voltage, over voltage etc failures happened, the controller will immediately shut down the pump running and automatically execute a check for restarting conditions after a built in time delay has elapsed. The controller will not recover automatically until all the abnormal situation(s) have been cleared.

5 TROUBLE SHOOTING GUIDE

Fault Message	Possible Cause	Solutions
flashing of UNDER V	the real running voltage is lower than the calibrated voltage, pump is in under voltage protection state	report low line voltage to the power supply company
		product will attempt to restart the pump every 5minutes until line voltage is restored to normal
flashing of OVER V	the real running voltage is higher than the calibrated voltage, pump is in over voltage protection state	report high line voltage to the power supply company
		product will attempt to restart the pump every 5minutes until line voltage is restored to normal
flashing of OVER LOAD	the real running ampere is higher than the calibrated running ampere, pump is in over load protection state	product will attempt to restart the pump every 30minutes until running ampere is restored to normal
	pump impeller is jammed / pump motor dragging / pump bearing broken	check pump impeller or bearing
flashing of NO CALIBR	parameter calibration not completed	refer to parameter calibration setting
flashing of DRY RUN	liquid level in the well / sump is below the pump intake, pump stops running	product will attempt to restart the pump every 30minutes until liquid level above the pump intake
flashing of STALLED	pump motor running ampere increasing was greater than the normal running ampere (calibrated ampere) by more than 200%	cut off power supply & repair or replace pump immediately